Address: MAPLE GROVE/8027 ITHACA LN PARKWAY
Feeder: ECK062
Voltage: 7.9 kVA
Replace Faulted Span: TR H1 - G1
Task 1: Bore 706' Single Phase #2 AL TR H1 - G1

Task 2: Terminate TR H1 - G1
Replace basements at TR H1 - G1

Task 3: Restore

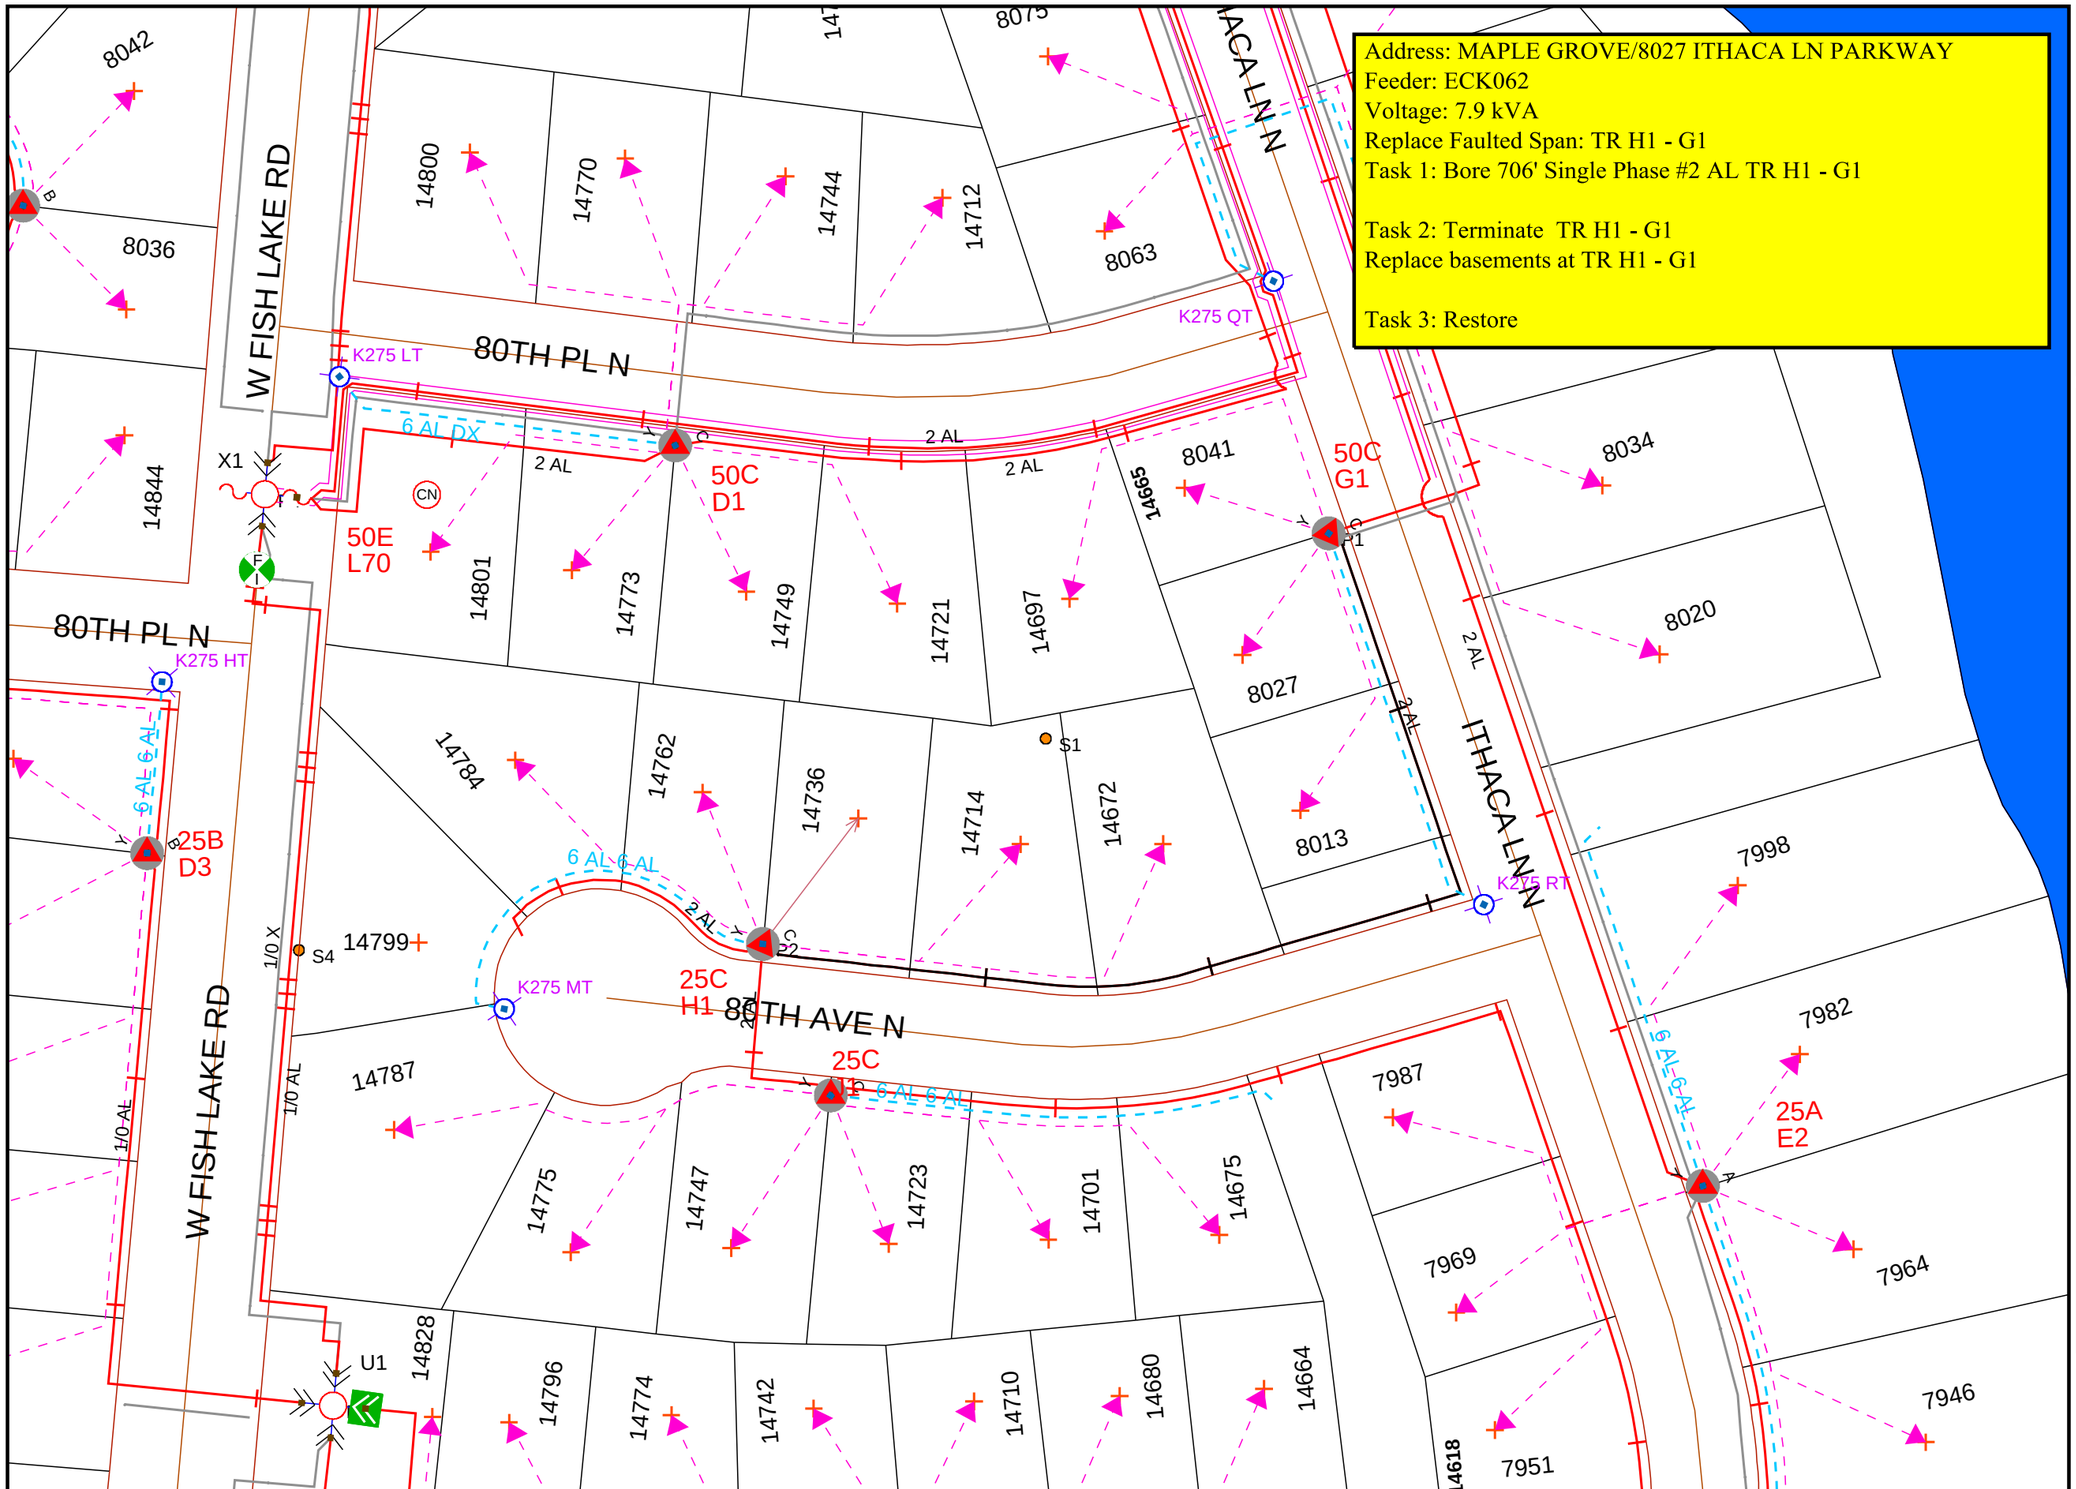

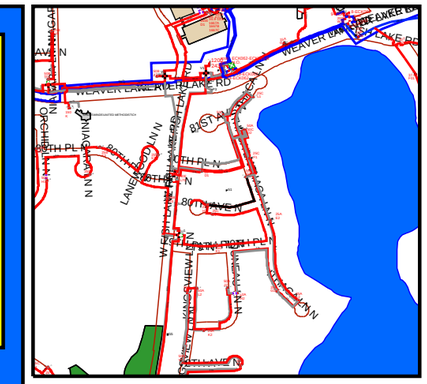

Work Order Information		
Service Request #	:	
Design Number	:	704744
Designer/Planner ID	:	216166
Designer/Planner Name	:	Joel.Feik@xcelenergy.com
Designer/Planner Ph #	:	(651) 415 -3836
Manager Approval	:	

Joint Utility	
E:	G:
T:	C:

Design Location		
Division	:	Maple Grove
County	:	Hennepin
City	:	Maple Grove
Address	:	
T: 119N R: 22W S: 21		
Map # : K52075	Permit :	

Electric	
Feeder:	Voltage:
Phase:	Bkup Dev ID:

Gas			
System	:	Pressure	:
Size	:	Material	:
Dead End	:		

Work Order # :

Date: 09/06/2017

Sketch: # Of # Sketch Data

Scale: 1" equals 83'

Xcel Energy

CONSTRUCTION USE ONLY

- ☐ NO CHANGES (BUILT AS DESIGNED)
- ☐ CHANGES MADE AS INDICATED (ALL URD MUST HAVE ACTUAL MEASUREMENTS FROM THE FIELD SITE)

RFO _____

FOREMAN _____ DATE _____

TEAM LEADER _____

DISCLAIMER: THERE ARE NO REPRESENTATIONS OR WARRANTIES (EXPRESS OR IMPLIED) ABOUT THE ACCURACY OF THIS PRINT. THIS PRINT IS PROVIDED WITH NO CLAIM AS TO PRINT COMPLETENESS, TIMELINESS, ACCURACY OF CONTENT OR USEFULNESS. STATE LAW REQUIRES ANYONE DIGGING, GRADING OR EXCAVATING TO OBTAIN A PRIOR FIELD LOCATE OF ALL UTILITIES; THIS PRINT DOES NOT DISCHARGE THIS REQUIREMENT OR ANY OTHER REQUIREMENT. THE COMPANY AND ITS AFFILIATES ASSUME NO LEGAL RESPONSIBILITY OR LIABILITY FOR THE RECIPIENT'S USE (OR ANY OTHER PARTIES' USE) OF THE PRINT, INCLUDING THE RECIPIENTS INTENDED PURPOSE IN USING THE PRINT. NO COMPANY EMPLOYEE OR OTHER PARTY HAS BEEN AUTHORIZED TO PROVIDE THIS PRINT FOR PLANNING OR ESTIMATING PURPOSES; RELY ON THIS PRINT AT YOUR OWN RISK. BY ACCEPTING THIS PRINT, THE RECIPIENT & ANY OTHER PARTY RECEIVING A COPY OF THE PRINT ACKNOWLEDGES AND AGREES TO THIS DISCLAIMER. For All Field Locates Call 811