GENERAL LOCATION ONLY.
DO NOT USE TO LOCATE FOR EXCAVATION.
CALL 1-800-252-1166 FOR ONSITE LOCATIONS AND STAKING.

CenterPoint Energy

Scale: 1" : 52 '

North

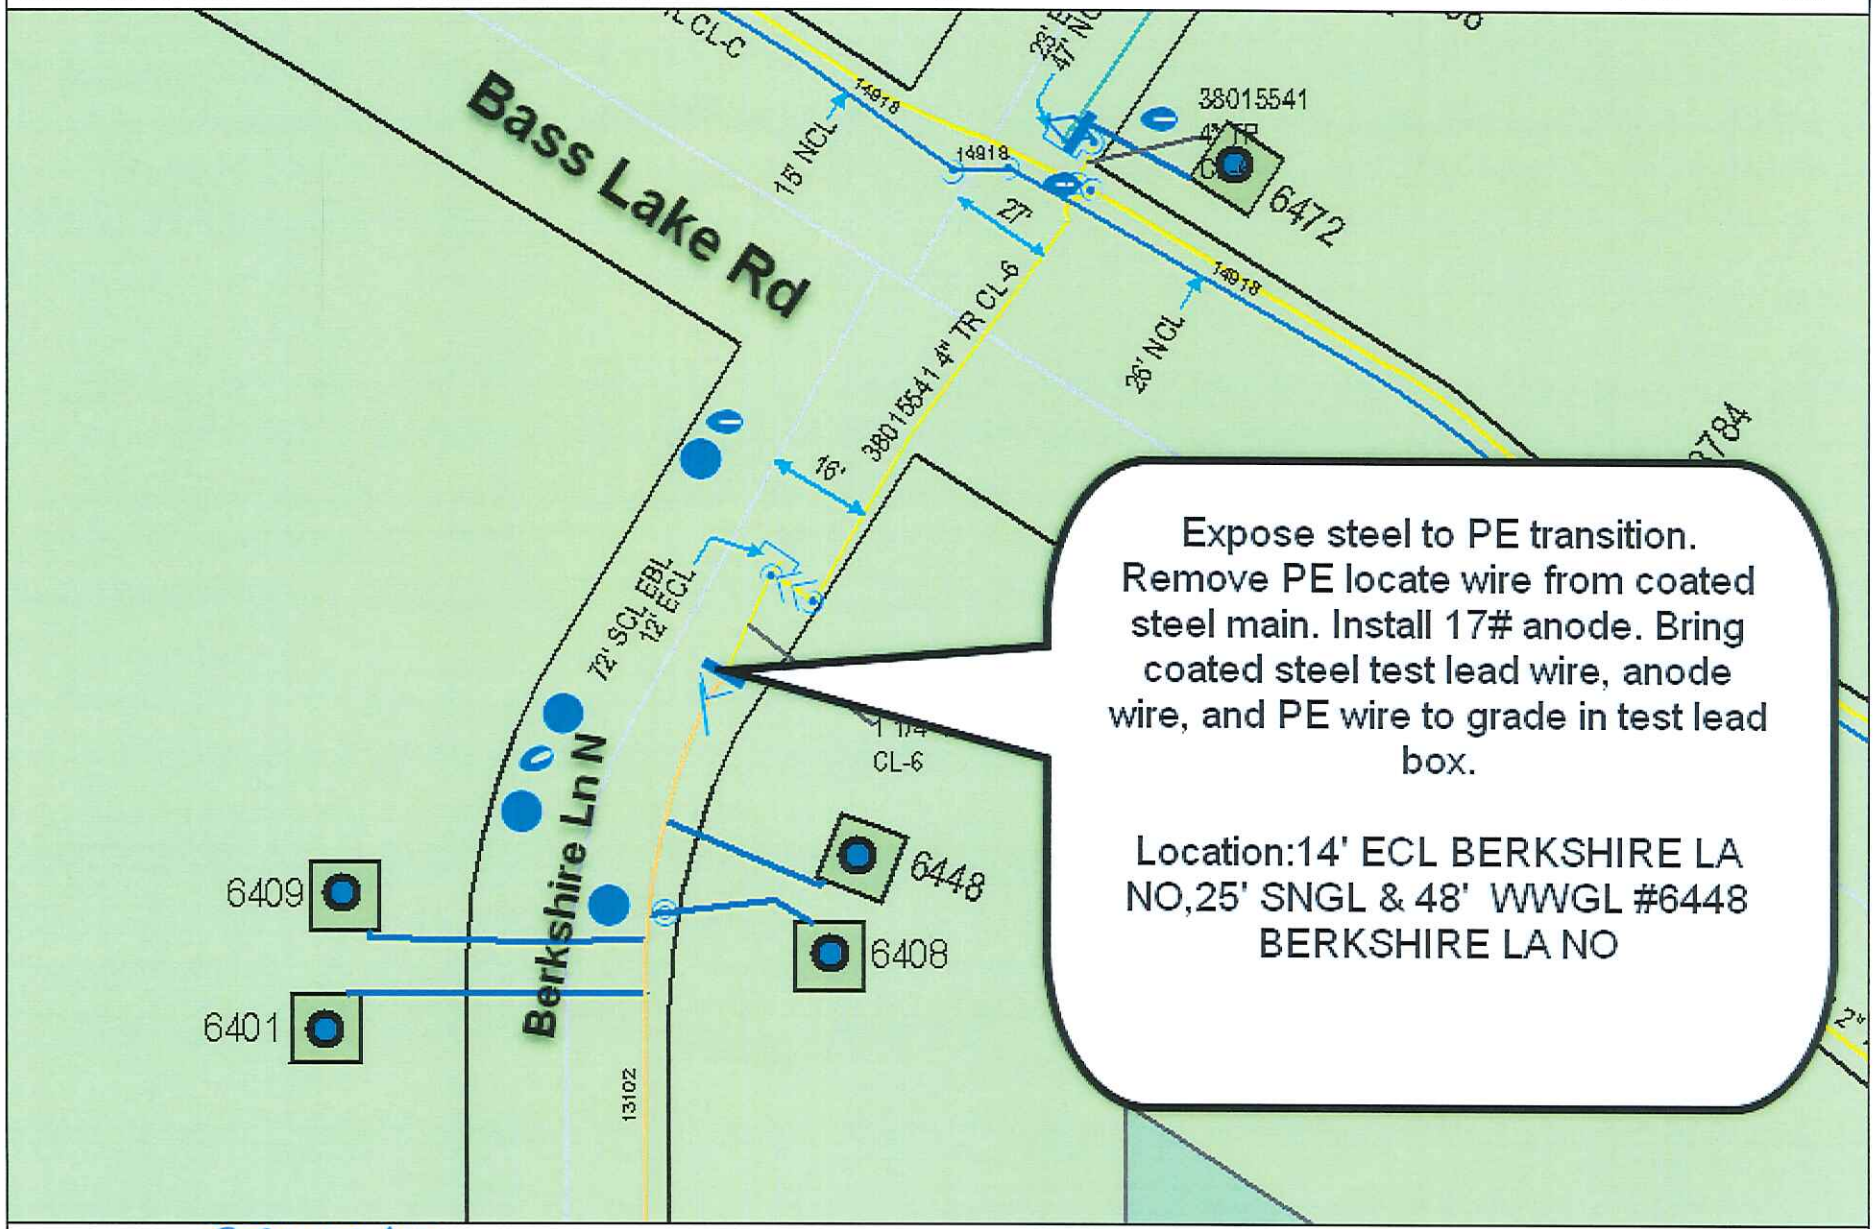

Expose steel to PE transition. Remove PE locate wire from coated steel main. Install 17# anode. Bring coated steel test lead wire, anode wire, and PE wire to grade in test lead box.

Location:14' ECL BERKSHIRE LA NO,25' SNGL & 48' WWGL #6448 BERKSHIRE LA NO

Work Order #: 87242410
Design Date: 08/10/2018

City: Maple Grove
Quad/Sec/Twp/Rng: SW1/4, Sec 34, 119/22

CP Section #: 13102
CP Area: 316

Designed By: Dan Peters
Designer Phone #: 612-581-9720