



PROPRIETARY AND CONFIDENTIAL

87687490

M52900 MAPLE GROVE

ONE CALL:
Hennepin
*SE23 T119/R22
* = this Page

LEGEND:

	ACTIVE		Interruptible
	DESIGNED		Existing
	PROPOSED		Normal
	ABANDONED		Future
	ABANDONED		Proposed


Address: 8001 FORESTVIEW LN N
 Customer: LIFE TIME SWIM
 Contact Person: DAN IBRAHIM
 Contact Phone: 952-334-3409
 Sales Rep: SHELLY HOUE
 Sales Rep Phone: 763-785-5428
 Construction Hotline: 612-321-5310
 Copies To Pipeline Integrity: No
 Curb Valve: No
 Copies to Corrosion: No
 Corrosion Approval: NA
 Follow Internal Pipe Sampling Requirements? No
 GFIP#: N/A
 Permits: CITY
 Requested Install Date: 10/07/18
 Approval: **JGM 9/29/16**

PROJECT DESCRIPTION:
LIFE TIME SWIM

DESIGNER: Stacie Yerks
 PHONE #: 612-321-5279
 DRAWN BY: Stacie Yerks
 DESIGN DATE: 9/25/2018

Revised Print
 Destroy All Others
 Revision History
 Date:
 Description:
 Design Approval:

IC Services
 SCAN DATE: 11/12/2018
 1" : 100'
 SHEET 1 OF 1

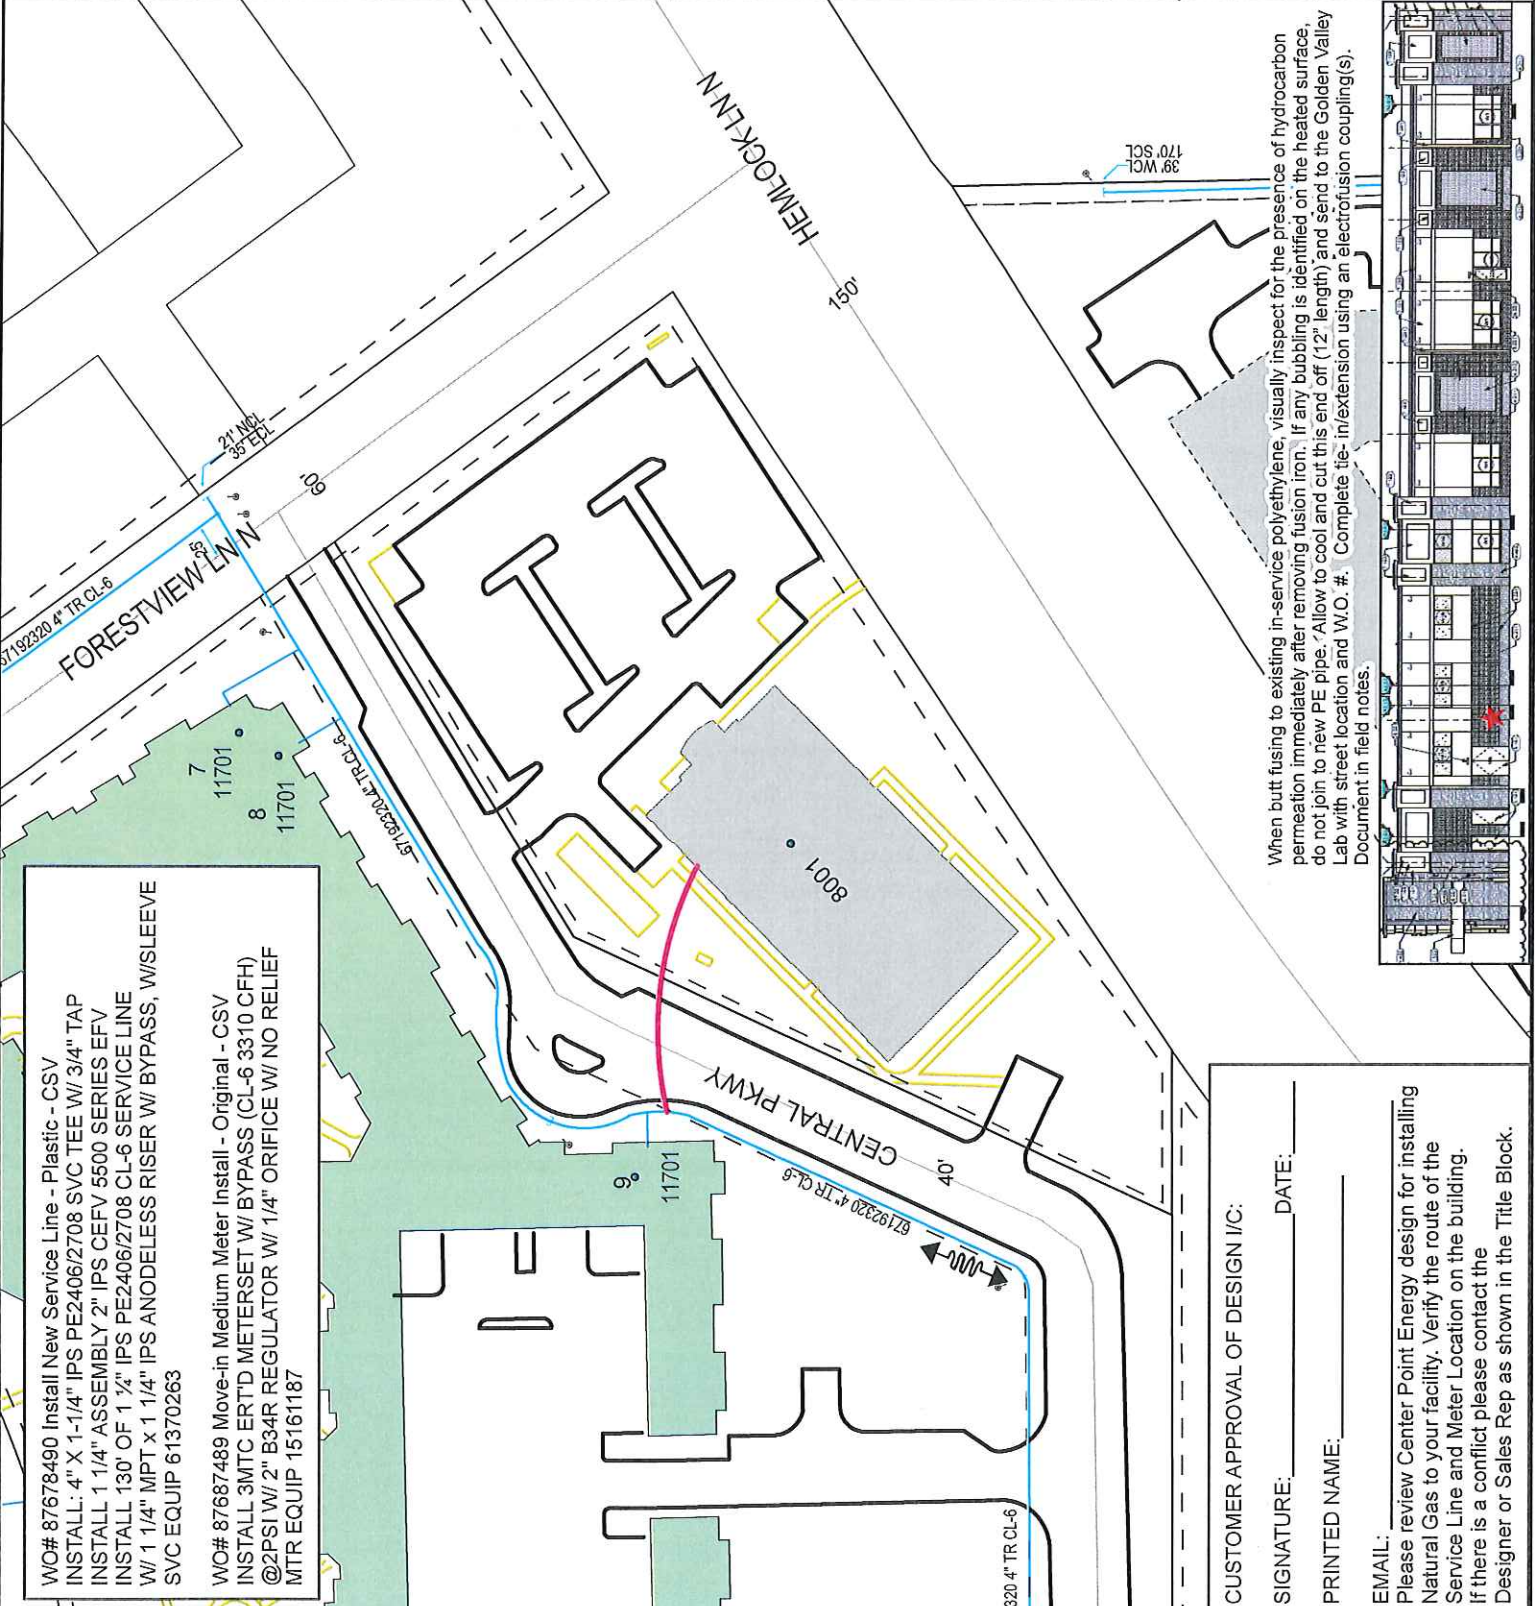

WO# 87678490 Install New Service Line - Plastic - CSV
 INSTALL: 4" X 1-1/4" IPS PE2406/2708 SVC TEE W/ 3/4" TAP
 INSTALL 1 1/4" ASSEMBLY 2" IPS CEFV 5500 SERIES EFV
 INSTALL 130' OF 1 1/2" IPS PE2406/2708 CL-6 SERVICE LINE
 W/ 1 1/4" MPT x 1 1/4" IPS ANODELESS RISER W/ BYPASS, W/SLEEVE
 SVC EQUIP 61370263

WO# 87687489 Move-in Medium Meter Install - Original - CSV
 INSTALL 3MTC ERTD METERSET W/ BYPASS (CL-6 3310 CFH)
 @2PSI W/ 2" B34R REGULATOR W/ 1/4" ORIFICE W/ NO RELIEF
 MTR EQUIP 15161187

CUSTOMER APPROVAL OF DESIGN I/C:
 SIGNATURE: _____ DATE: _____
 PRINTED NAME: _____
 EMAIL: _____
 Please review Center Point Energy design for installing Natural Gas to your facility. Verify the route of the Service Line and Meter Location on the building. If there is a conflict please contact the Designer or Sales Rep as shown in the Title Block.

When butt fusing to existing in-service polyethylene, visually inspect for the presence of hydrocarbon permeation immediately after removing fusion iron. If any bubbling is identified on the heated surface, do not join to new PE pipe. Allow to cool and cut this end off (12" length) and send to the Golden Valley Lab with street location and W.O. #. Complete tie-in/extension using an electrofusion coupling(s). Document in field notes.

