


CVS Pharmacy
6300 Wedgewood Rd. N
Maple Grove, 55311
DB 20896029

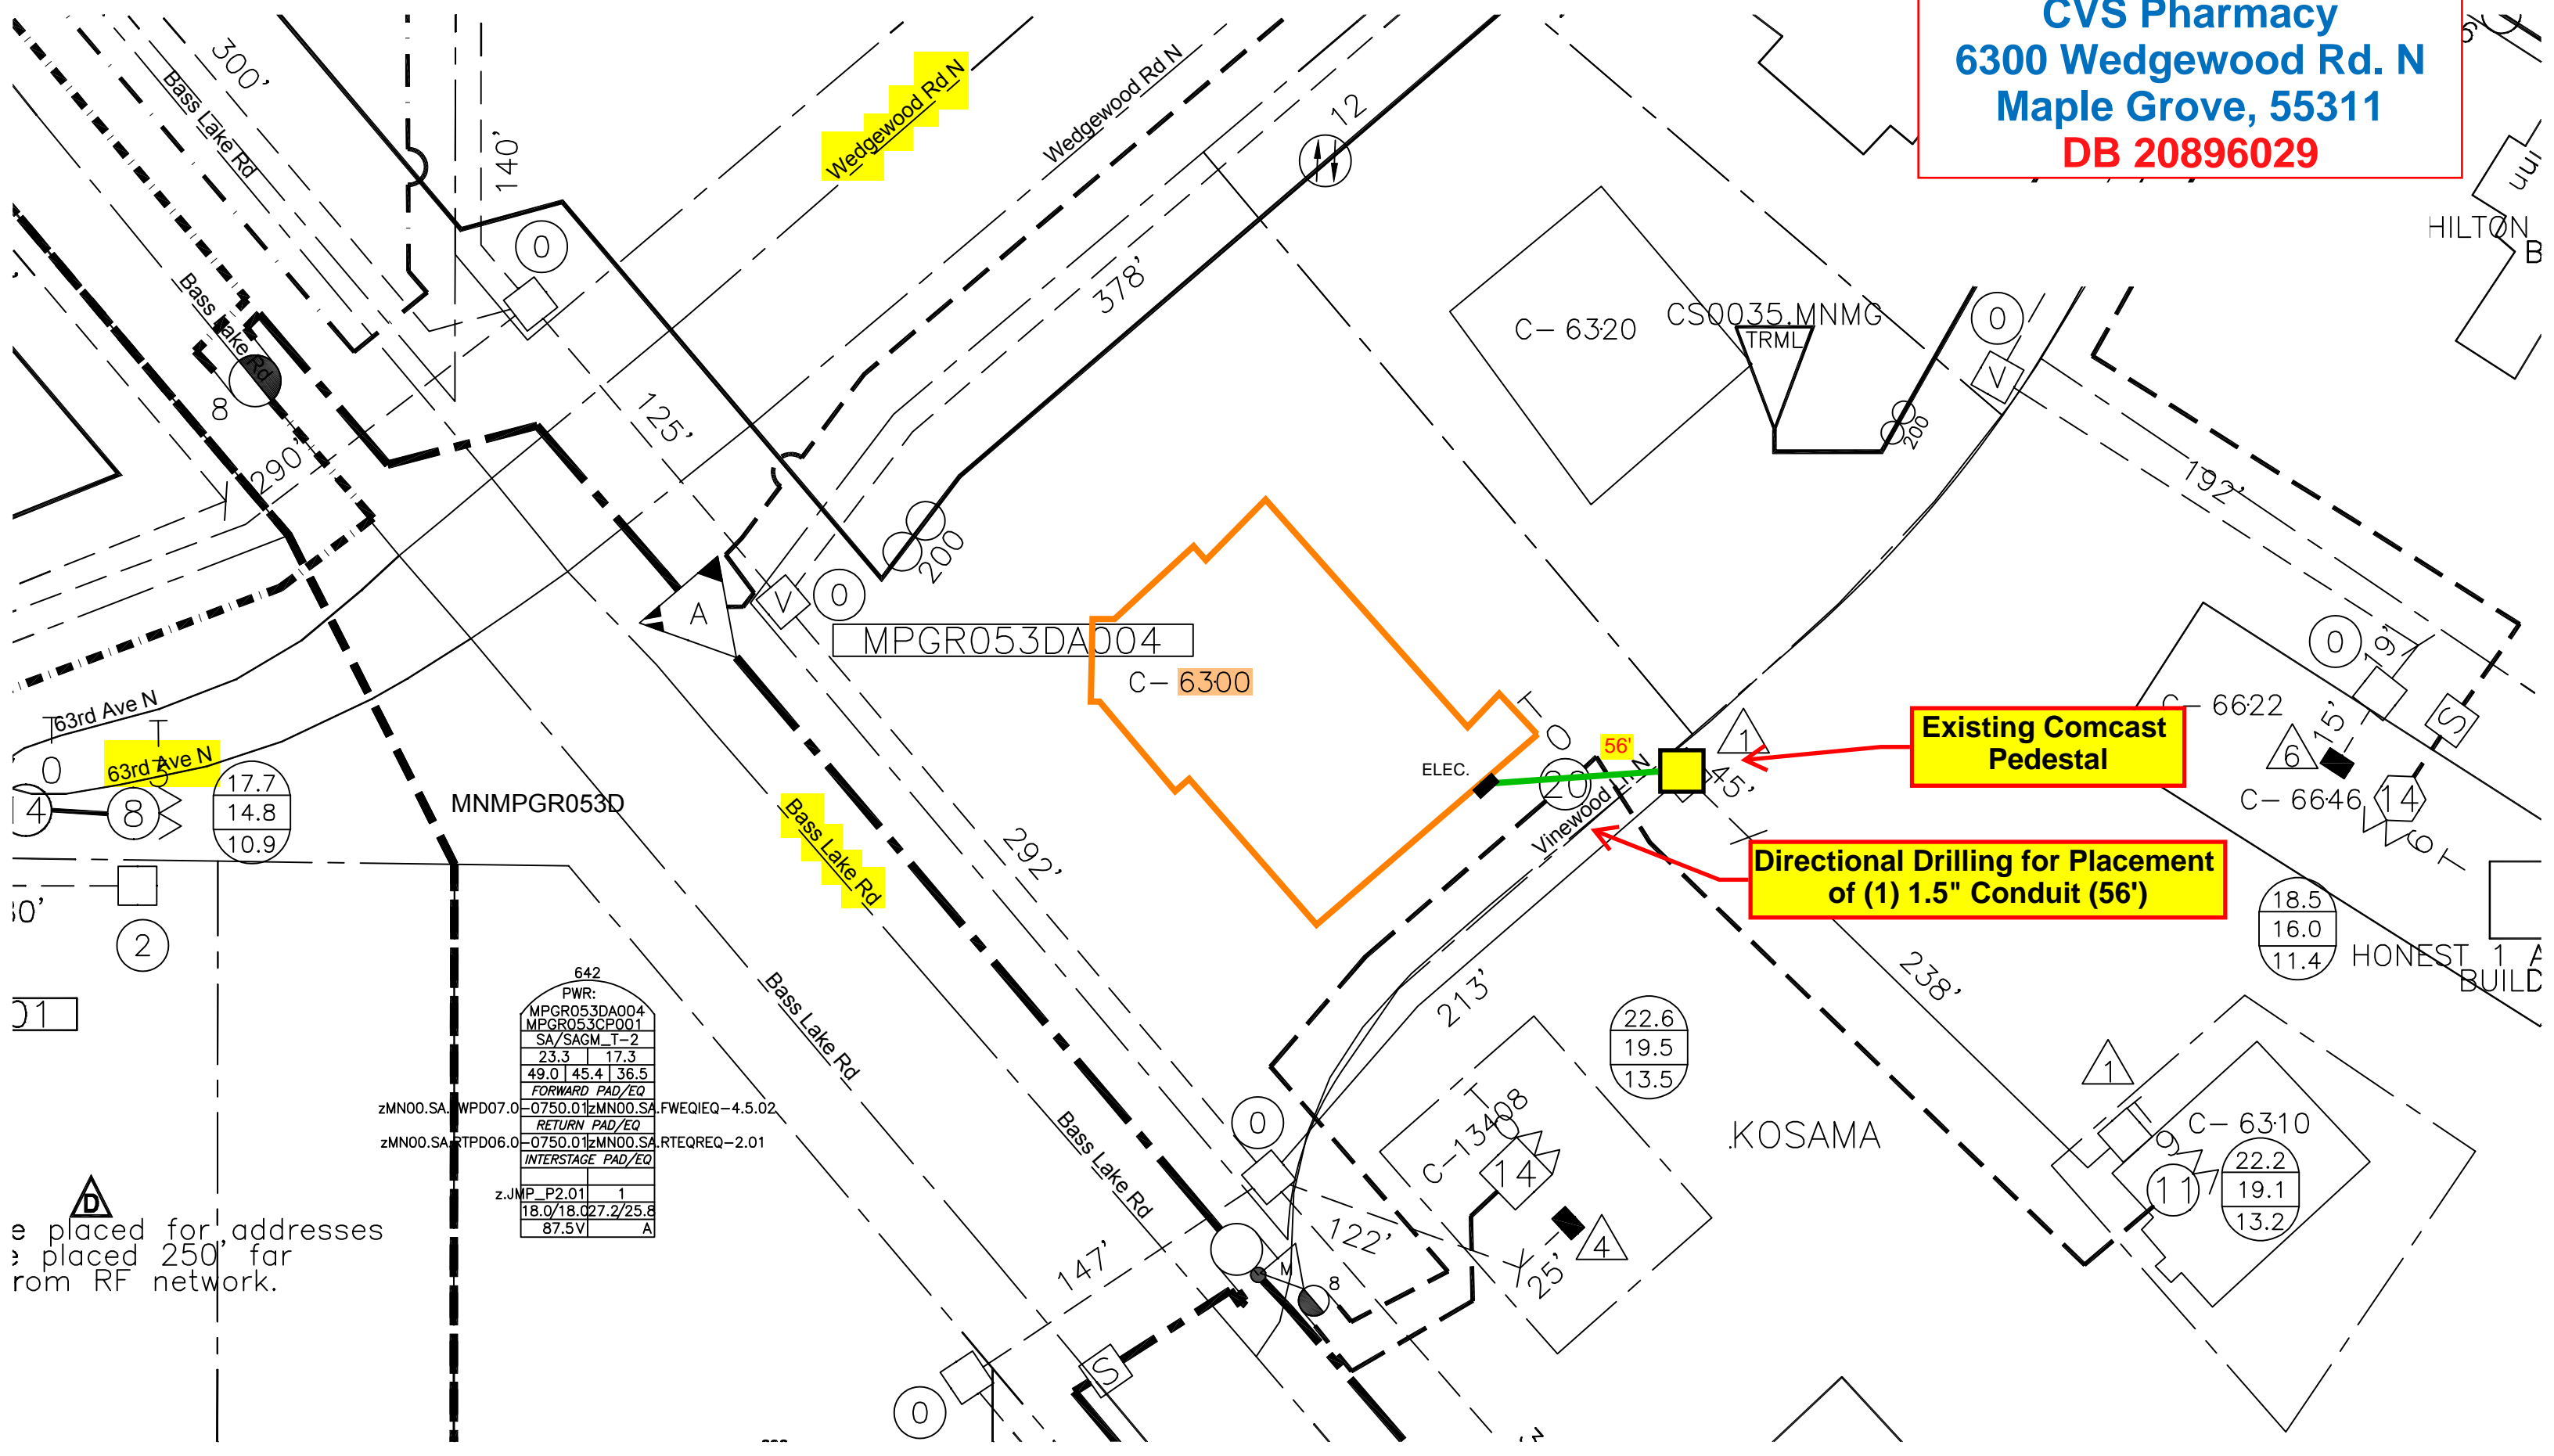

Existing Comcast Pedestal

Directional Drilling for Placement of (1) 1.5" Conduit (56')

| | | |
|-------------------|----------|-------------------------|
| 642 | | |
| PWR: | | |
| MPGR053DA004 | | |
| MPGR053CP001 | | |
| SA/SAGM_T-2 | | |
| 23.3 | 17.3 | |
| 49.0 | 45.4 | 36.5 |
| FORWARD PAD/EQ | | |
| zMN00.SA.WPD07.0 | -0750.01 | zMN00.SA.FWEQIEQ-4.5.02 |
| RETURN PAD/EQ | | |
| zMN00.SA.RTPD06.0 | -0750.01 | zMN00.SA.RTEQREQ-2.01 |
| INTERSTAGE PAD/EQ | | |
| z.JMP_P2.01 | | |
| 18.0 | 18.0 | 27.2/25.8 |
| 87.5V | | A |

Addresses placed for addresses placed 250' far from RF network.