

NOTE: BORE ALL PAVED STREETS AND DRIVEWAYS
 Minimum depth requirements for crossings of state highways and county roads is 60". Minimum depth requirements for crossings of city streets and township roads is 48".
 Minimum depth for parallel installations on state highways and county roads is 35". Minimum depth for parallel installations on city streets and township roads is 30". All steel pipe welds to be coated with 2 part epoxy.

INSTALL LOCATING POINTS AT A MAXIMUM SPACING OF 1,000 FT.

INSTALL 2" PE CL-6 MAIN IN 10' UTILITY EASEMENT THAT IS ADJACENT TO PROPERTY LINE

T = INSTALL 2" PE TEE
 C = INSTALL 2" PE CAP TO COVER SERVICE

Purge new main until essentially 100% gas reading is obtained on Combustible Gas Indicator. See CenterPoint Energy Construction and Service Manual Section CS-B-1.230 for purging mains into service.

Install a marker ball at a new end of main, at a valve, at each end of a horizontal offset, at road crossings and at any fitting or pressure control identified as needing to be located in the future. Refer to CenterPoint Energy Construction and Service Manual section CS-B-1.310 for installation procedures.

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the state of Minnesota.

Signature: *Casey Tollefson*

Typed or Printed Name: Casey Tollefson


Date: 10/4/16 License Number: 52693



EXISTING
 6" TR CL-6, 52316853-2010
 50' SCL BASS LAKE RD
 INSTALL
 6" x 2" PE HVPT
 CONTINUE 2" PE SOUTHWEST

INSTALL
 2" PE CAP
 5' WEST OF ROW LINE

INSTALL
 2" PE CAP
 AT END OF ROAD
 CONSTRUCTION

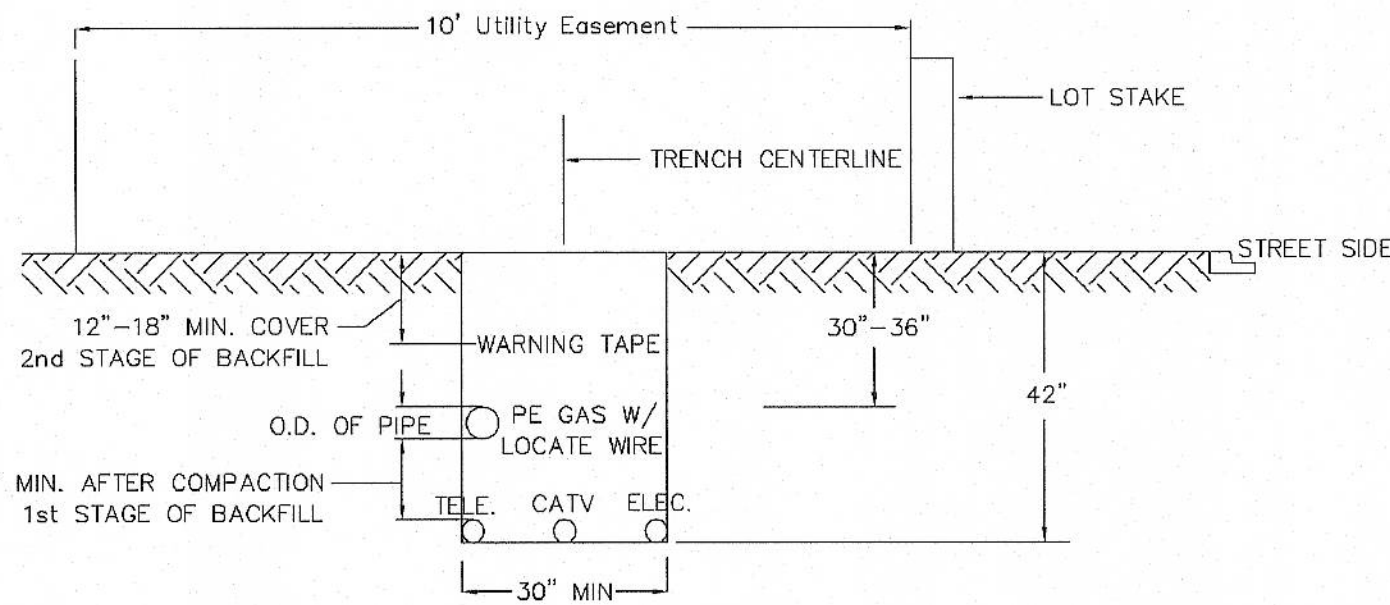

DESIGNER EXPRESS DESIGN 10/3/2016 12:04:50 PM

DUAL MAIN IN UTILITY EASEMENT