

PREPARED BY: C
 AM A DAILY
 THE STATE
 SIGNATURE
 TYPED OR
 DATE: 11


NORTH ELEVATION

2' RLBL

METER W/O# 90708874 - I/C Install SmVol Gas Meter - CSV
 INSTALL: 630TC OSM ERT'D METERSET (CL-6 1154CFH)
 W/ 3/4" X 1" 1813C REG @2#PSI, W/ 3/16" ORIFICE
 OFF 1-1/4" STYLE F ANODELESS RISER W/BYPASS, W/SLEEVE
 @ 2' RLBL ON NORTH WALL
 METER EQUIP# 15278519

CUSTOMER APPROVAL OF DESIGN I/C:
 SIGNATURE: _____
 PRINTED NAME: _____ DATE: _____
 Please review Center Point Energy design for installing Natural Gas to your facility. Verify the route of the Service Line and Meter Location on the building. If there is a conflict please contact the Designer or Sales Rep as shown in the Title Block. Before a natural gas service lines can be installed, you must clearly mark all privately-owned underground facilities including: septic tanks, drain fields, sewer lines, water wells, sprinkler systems, invisible fences, electric lines and pipelines. CenterPoint Energy and its representatives are not responsible for damage to these items if they are not clearly marked at time of installation.

WHEN BUTT FUSING TO EXISTING IN-SERVICE POLYETHYLENE, VISUALLY INSPECT FOR THE PRESENCE OF HYDROCARBON PERMEATION IMMEDIATELY AFTER REMOVING FUSION IRON. IF ANY BUBBLING IS IDENTIFIED ON THE HEATED SURFACE, DO NOT JOIN TO NEW PE PIPE. ALLOW TO COOL AND CUT THIS END OFF (12" LENGTH) AND SEND TO THE GOLDEN VALLEY LAB WITH STREET LOCATION AND W.O. #. COMPLETE TIE- IN/EXTENSION USING AN ELECTROFUSION COUPLING(S). DOCUMENT IN FIELD NOTES.

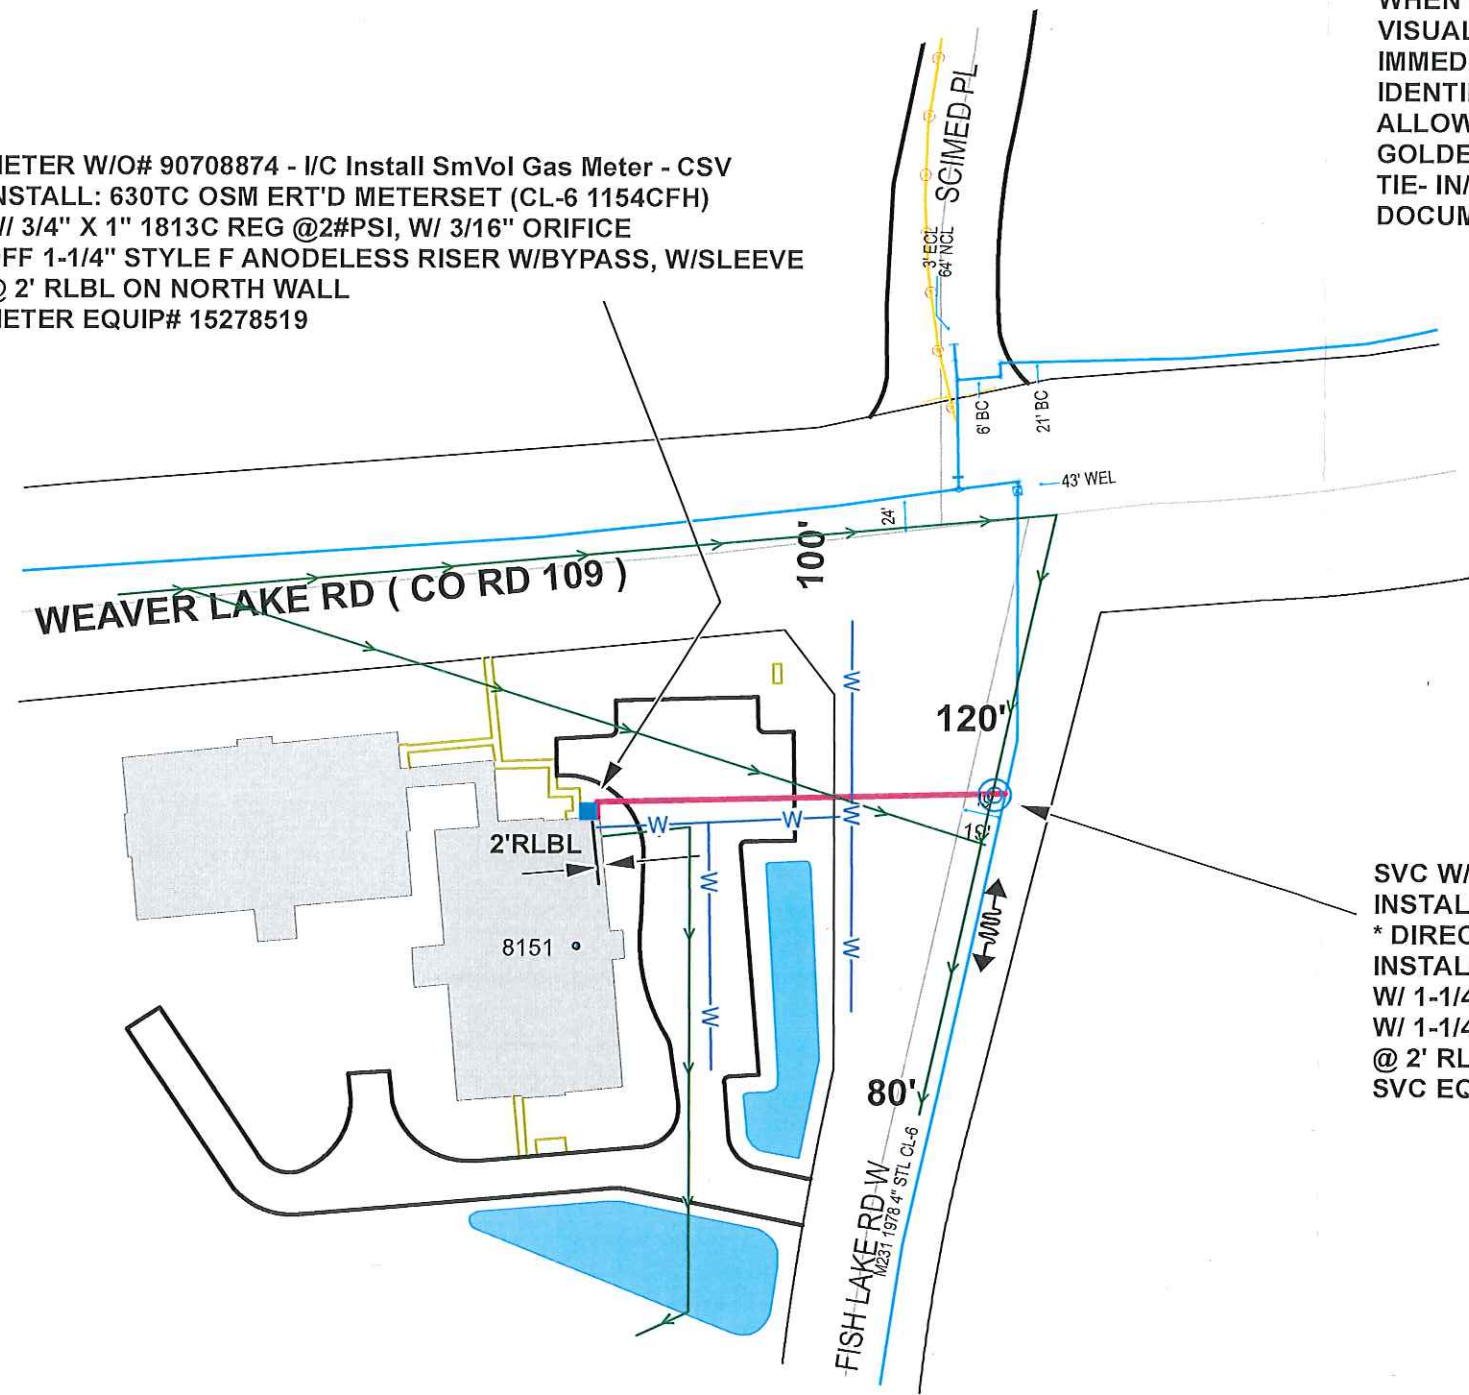

→ SANITARY SEWER
 —W—W WATER MAIN

SVC W/O# 90708884 - Install I/C New Service Line-Plastic - CSV
 INSTALL: 3-WAY TEE W/1-1/4" TRANSITION W/17 ANODE @ MAIN
 * DIRECTIONAL BORE ENTIRE SERVICE LINE FROM FISH LAKE RD W *
 INSTALL: 225' OF 1-1/4" IPS PE CL-6 SVC LINE
 W/ 1-1/4" PE 5500 SERIES EFV (ASSEMBLY) OFF TEE
 W/ 1-1/4" MPT x 1-1/4" IPS ANODELESS RISER W/ BYPASS, W/SLEEVE
 @ 2' RLBL ON NORTH WALL
 SVC EQUIP# 64640965

Project area cleared for internal impacts. Pipe being removed is unregulated for disposal if coating does not exist or is non-asbestos. Refer to CNP Construction and Service Manual CS-B-1.110, CS-B-1.330, and CS-B-1.100, for pipe to be abandoned.



PROPRIETARY AND CONFIDENTIAL

90708884
 M52900 MAPLE GROVE

ONE CALL:
 Hennepin
 *NE21 T119/R22
 *= this Page

- LEGEND:**
- ACTIVE
 - - - DESIGNED
 - · - · - PROPOSED
 - · - · - ABANDONED
 - · - · - ABANDONED

- Interruptible
- Existing
- Normal
- Future
- Proposed

Address: 8151 FISH LAKE RD W
 Customer: BEEHIVE ASSISTED LIVING
 Contact Person: ERNEST SMITH
 Contact Phone: 952-300-1927
 Sales Rep: MICHELE HOUE
 Sales Rep Phone: 763-785-5428
 Construction Hotline: 612-321-5310
 Copies To Pipeline Integrity: No
 Curb Valve: No
 Copies to Corrosion: Yes
 Corrosion Approval: MIKE MCCALL
 Follow Internal Pipe Sampling Requirements? No
 GFIP#: NA
 Permits: CITY- NO HOLD
 Requested Install Date: 8-11-19
 Approval: JGM 7/26/19

PROJECT DESCRIPTION:
 BEEHIVE ASSISTED LIVING

DESIGNER: Ronald McKibbon
 PHONE #: 612-321-5492
 DRAWN BY: Ronald McKibbon
 DESIGN DATE: 7/26/2019

Revised Print
 Destroy All Others
 Revision History
 Date:
 Description:
 Design Approval:

IC Services 1" : 100'
 SCAN DATE: SHEET 1 OF 1

7/26/2019 11:49:27 AM DESIGNER EXPRESS DESIGN