


Three Rivers Park District
14900 Bass Lake Rd.
Maple Grove, 55311
JB0000197764
Node: MNMPGR006
Legacy: D-A4-3

Key
Yellow Line = Existing Plant

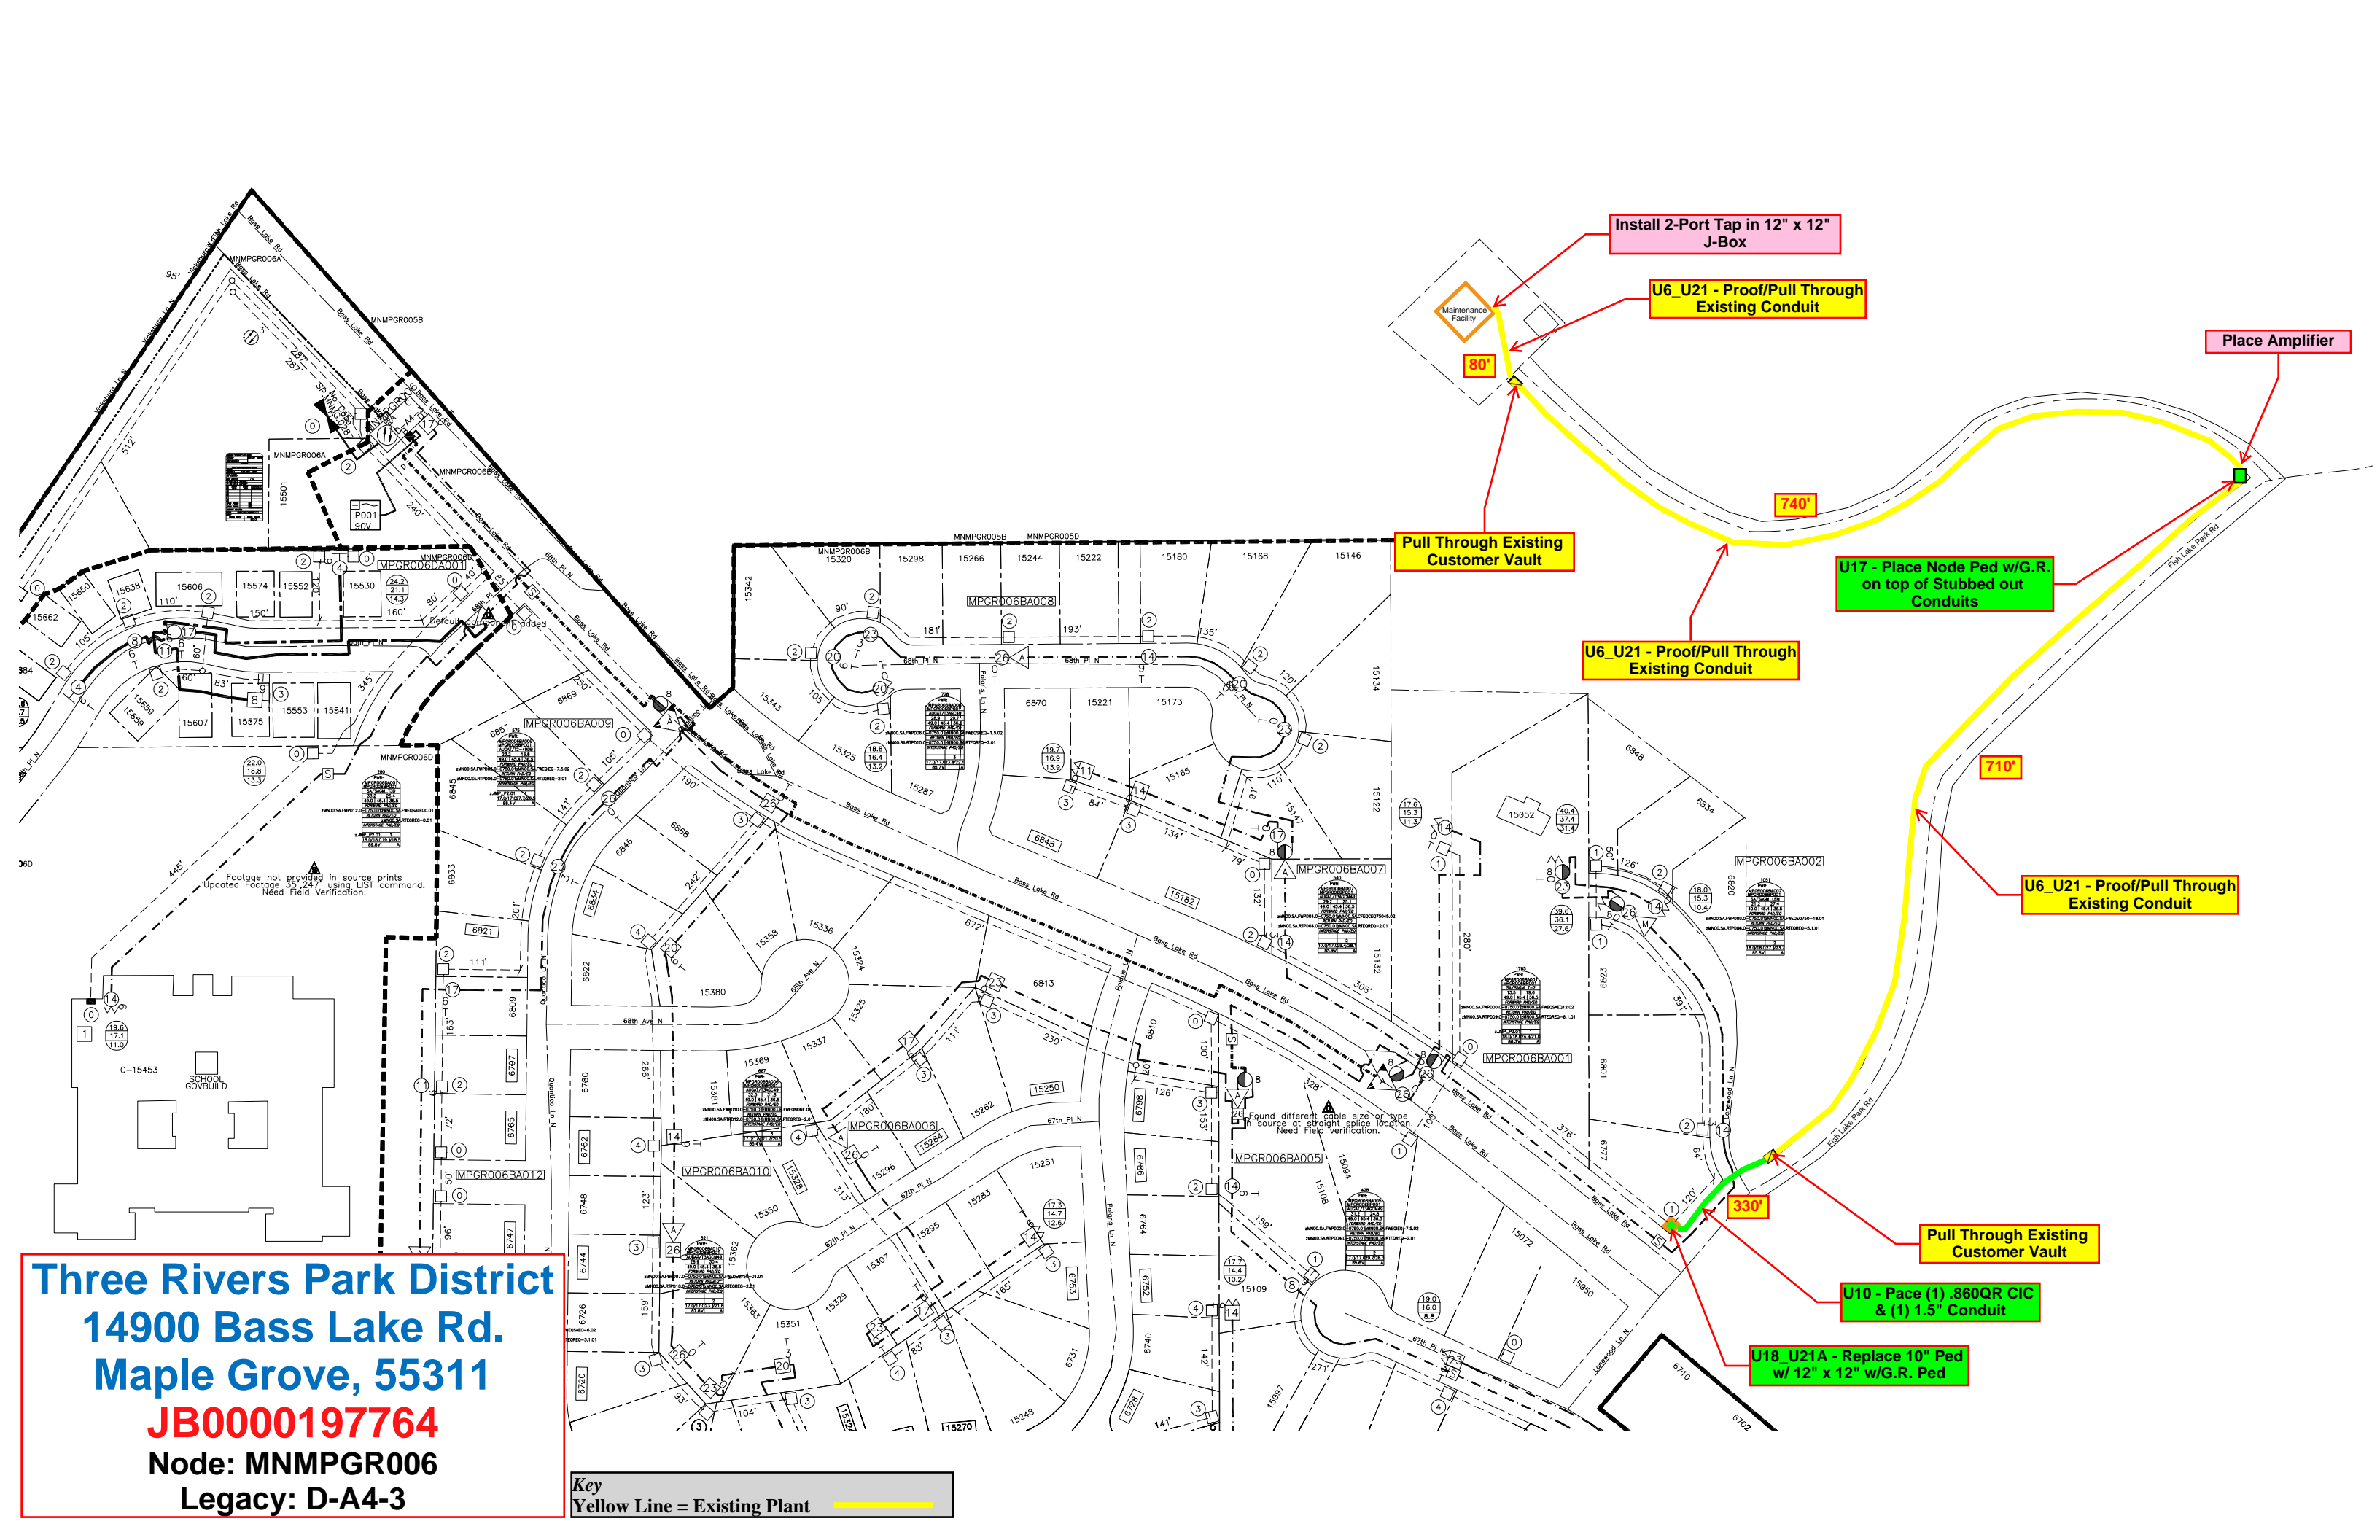

Install 2-Port Tap in 12" x 12" J-Box

U6_U21 - Proof/Pull Through Existing Conduit

Place Amplifier

Pull Through Existing Customer Vault

U17 - Place Node Ped w/G.R. on top of Stubbed out Conduits

U6_U21 - Proof/Pull Through Existing Conduit

U6_U21 - Proof/Pull Through Existing Conduit

Pull Through Existing Customer Vault

U10 - Place (1) .860QR CIC & (1) 1.5" Conduit

U18_U21A - Replace 10" Ped w/ 12" x 12" w/G.R. Ped

80'

740'

710'

330'