

14505 WEAVER LAKE RD
 ID: 33556582
 POI: K275 502
 ECK062/A/13.8kV

TASK 1: DIRECTIONAL BORE
 BORE IN 105' OF 4/0 AL UG TRIPLEX CABLE P1 TO P2


TASK 2: URD RISER
 REPLACE EX URD RISER AND 35' OF 1/0 AL UG TRIPLEX CABLE P1 TO SECONDARY

TASK 3: TERMINATION
 TERMINATE AT P1 AND P2

TASK 4: REMOVE ADD-A-PHASE

TASK 5: RESTORATION

NOTE: ABANDON EXISTING SVC CABLE IN PLACE
 REPLACE PADLOCK ON TRANSFORMER
 REMOVE ASPHALT BIKE PATH

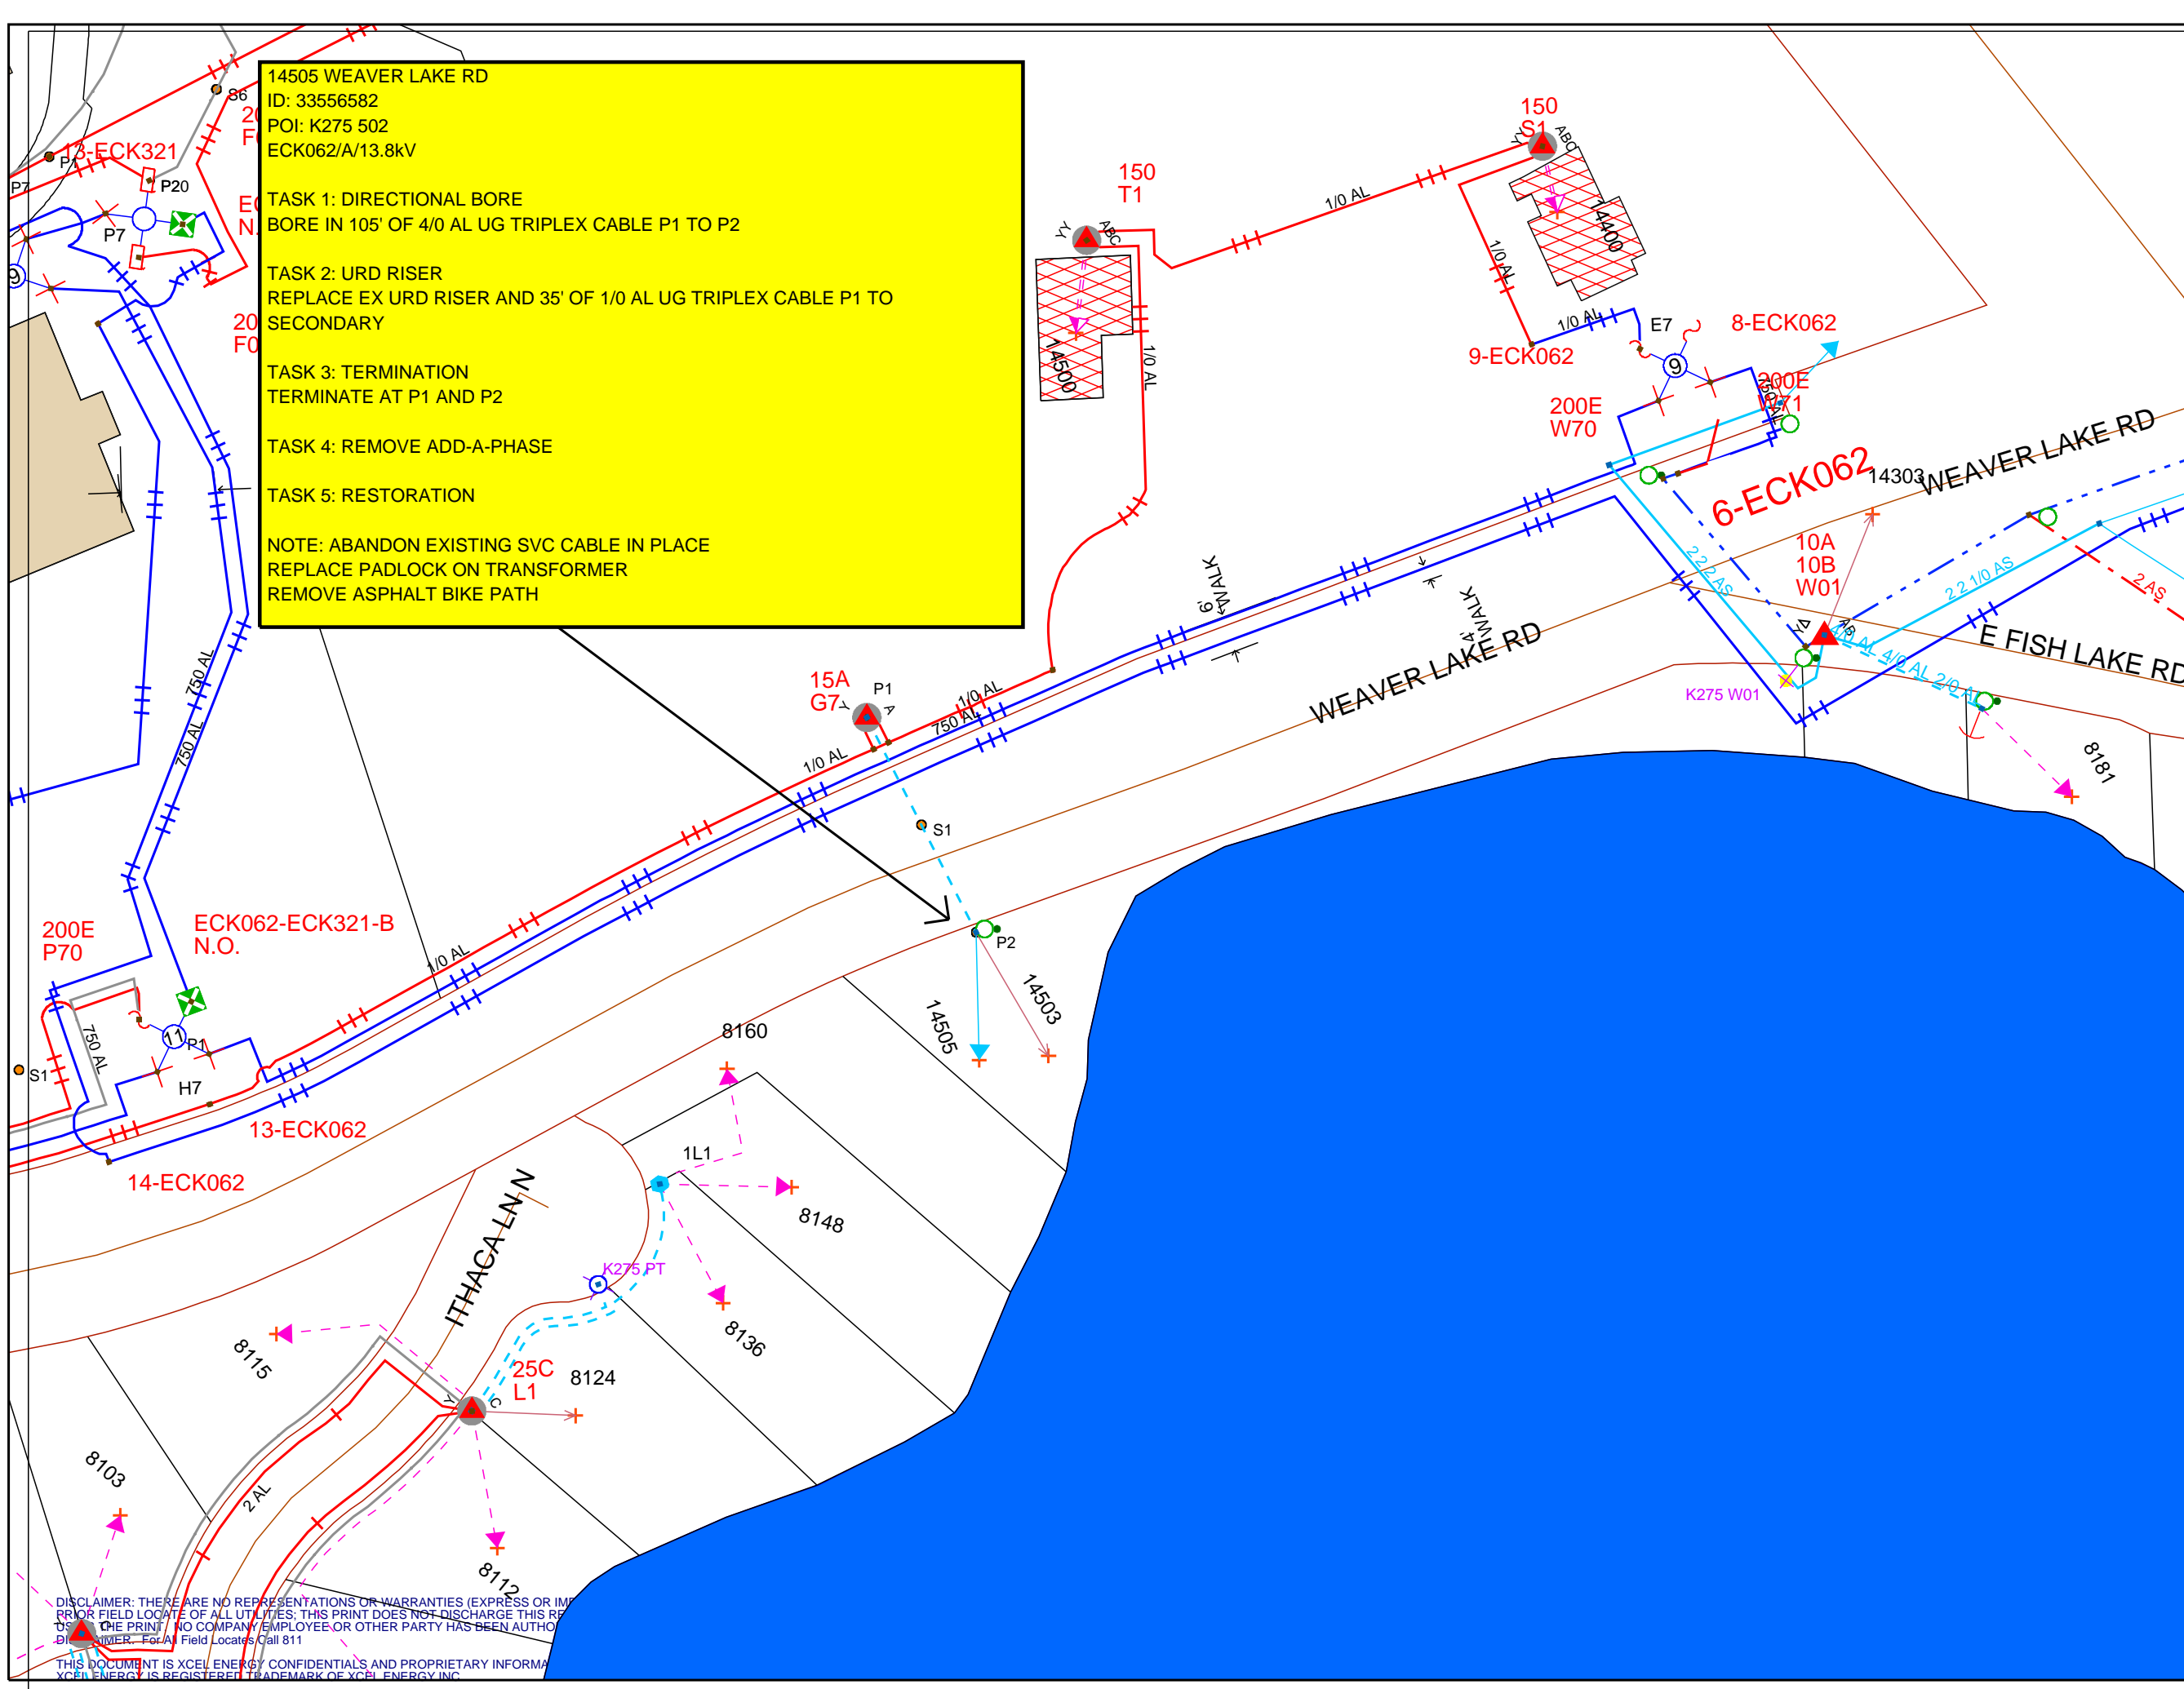

Work Order Information

Service Request #	:	
Design Number	:	00000974049
Designer/Planner ID	:	243322
Designer/Planner Name	:	Grosko, Deborah
Designer/Planner Ph #	:	(816) 414-1113
Manager Approval	:	

Joint Utility

E:	G:
T:	C:

Design Location

Division	:	Maple Grove
County	:	Hennepin
City	:	Maple Grove
Address	:	14505 Weaver Lake Road
T: 119N	R: 22W	S: 21
Map #	:	K52075
Permit	:	Maple Grove

Electric


Feeder: ECK062	Voltage: 13.8kV
Phase: A	Bkup Dev ID:

Gas

System	:	Pressure	:
Size	:	Material	:
Dead End	:		

Work Order # : 00000105284808

Date: 10/07/2020
 Sketch: 1 Of 1 Sketch Data
 Scale: 1" equals 100'



CONSTRUCTION USE ONLY

- NO CHANGES (BUILT AS DESIGNED)
- CHANGES MADE AS INDICATED (ALL URD MUST HAVE ACTUAL MEASUREMENTS FROM THE FIELD SITE)

RFO _____
 FOREMAN _____ DATE _____
 TEAM LEADER _____

DISCLAIMER: THERE ARE NO REPRESENTATIONS OR WARRANTIES (EXPRESS OR IMPLIED) FOR THE FIELD LOCATE OF ALL UTILITIES. THIS PRINT DOES NOT DISCHARGE THIS RESPONSIBILITY. NO COMPANY EMPLOYEE OR OTHER PARTY HAS BEEN AUTHORIZED TO MAKE ANY CHANGES TO THIS PRINT. For All Field Locates Call 811
 THIS DOCUMENT IS XCEL ENERGY CONFIDENTIALS AND PROPRIETARY INFORMATION. XCEL ENERGY IS REGISTERED TRADEMARK OF XCEL ENERGY INC.