


**PG.1
BOSTON SCIENTIFIC- ADD 2ND ATO
VISTA GEAR**

ECK321 (2/3) ECK322 (4/4) 34.5KV

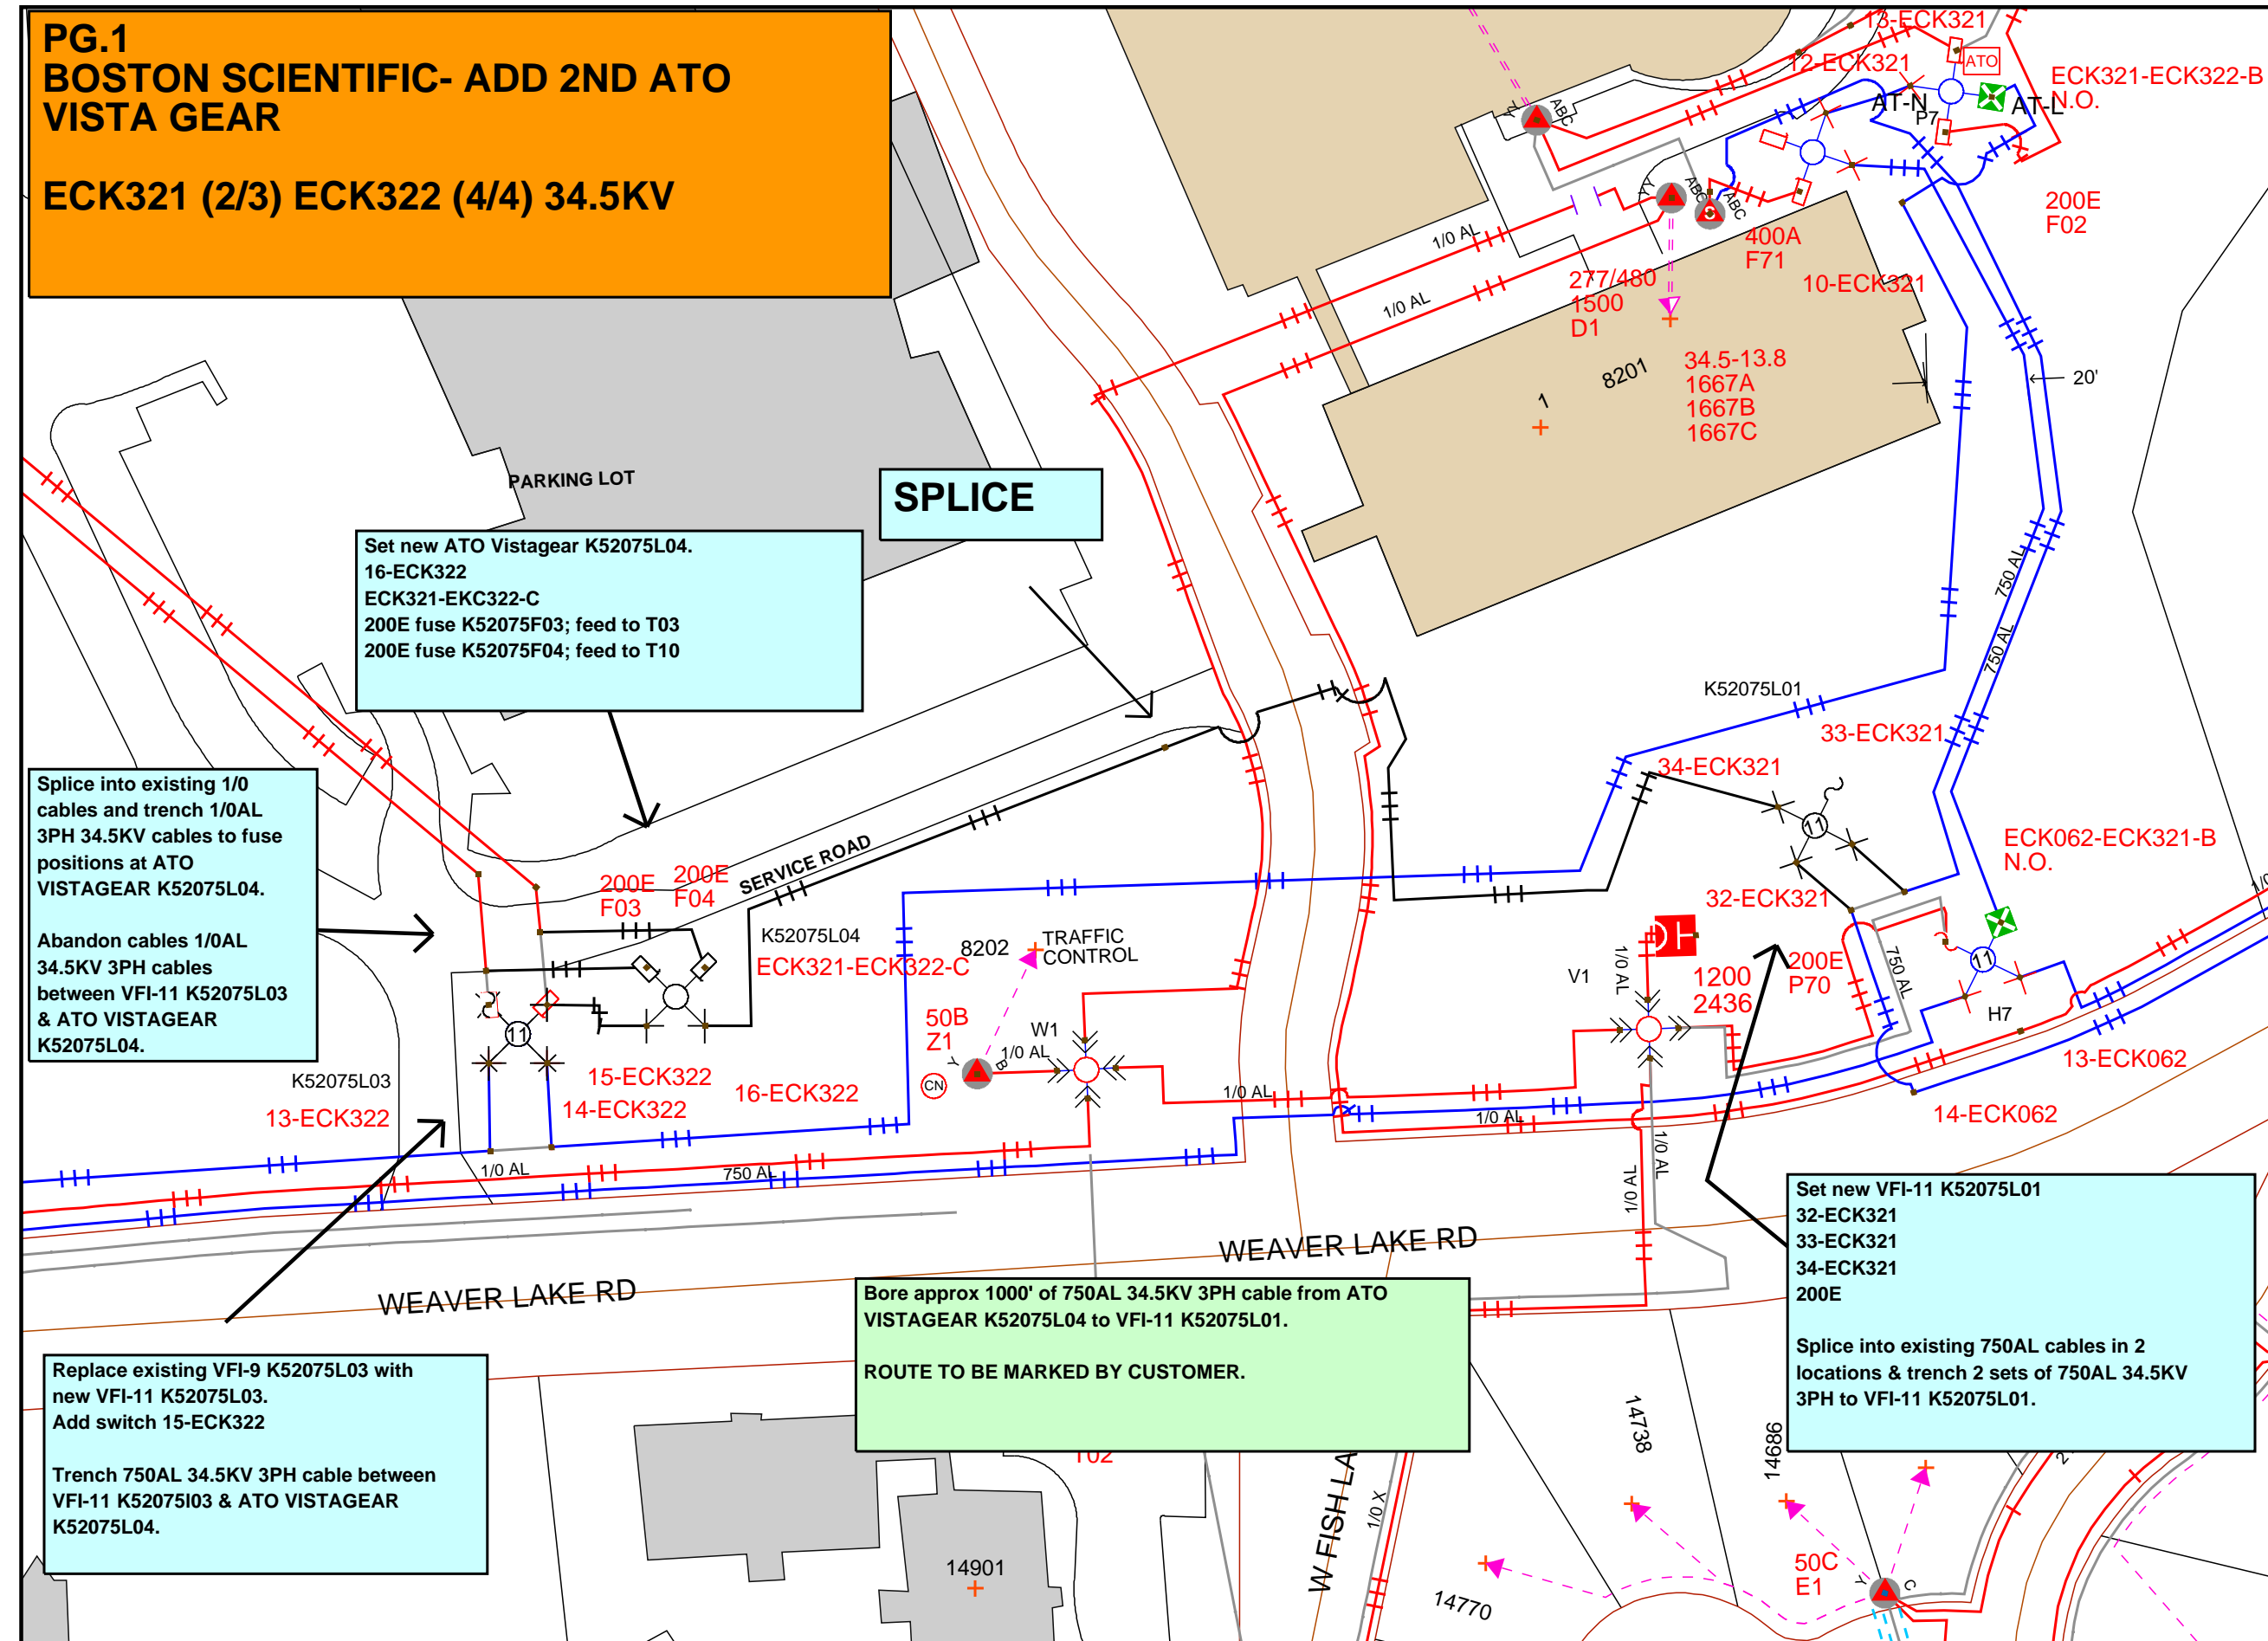

Set new ATO Vistagear K52075L04.
16-ECK322
ECK321-EKC322-C
200E fuse K52075F03; feed to T03
200E fuse K52075F04; feed to T10

Splice into existing 1/0 cables and trench 1/0AL 3PH 34.5KV cables to fuse positions at ATO VISTAGEAR K52075L04.

Abandon cables 1/0AL 34.5KV 3PH cables between VFI-11 K52075L03 & ATO VISTAGEAR K52075L04.


Replace existing VFI-9 K52075L03 with new VFI-11 K52075L03.
Add switch 15-ECK322

Trench 750AL 34.5KV 3PH cable between VFI-11 K52075L03 & ATO VISTAGEAR K52075L04.

Bore approx 1000' of 750AL 34.5KV 3PH cable from ATO VISTAGEAR K52075L04 to VFI-11 K52075L01.
ROUTE TO BE MARKED BY CUSTOMER.

Set new VFI-11 K52075L01
32-ECK321
33-ECK321
34-ECK321
200E

Splice into existing 750AL cables in 2 locations & trench 2 sets of 750AL 34.5KV 3PH to VFI-11 K52075L01.

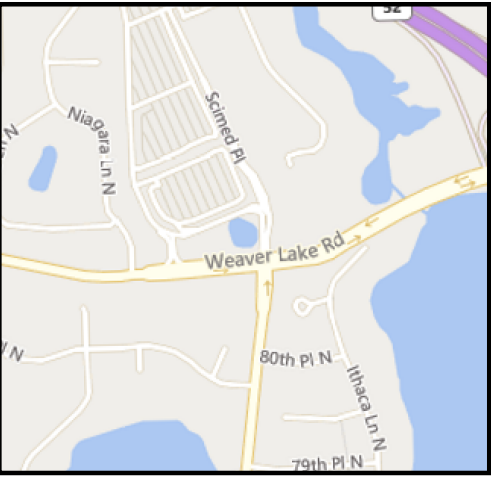

Work Order Information	
Service Request #	:
Design Number	: 000000913916
Designer/Planner ID	: 209876
Designer/Planner Name	: Pfothenauer, John
Designer/Planner Ph #	: (763) 493-1876
Manager Approval	:


Joint Utility	
E:	G:
T:	C:

Design Location	
Division	: Maple Grove
County	: HENNEPIN
City	: MAPLE GROVE
Address	: 2 SCIMED BLVD
T: 119N	R: 22W S: 21
Map #	: K52075 Permit :

Electric	
Feeder:	ECK321/322 Voltage: 34.5KV
Phase:	ABC Bkup Dev ID:

Gas	
System	: Pressure :
Size	: Material :
Dead End	:

Work Order # : 105751659
Date: 01/18/2021
Sketch: 1 Of 3 Sketch Data
Scale: 1" equals 100'



CONSTRUCTION USE ONLY	
<input type="checkbox"/>	NO CHANGES (BUILT AS DESIGNED)
<input type="checkbox"/>	CHANGES MADE AS INDICATED (ALL URD MUST HAVE ACTUAL MEASUREMENTS FROM THE FIELD SITE)

RFO _____
FOREMAN _____ DATE _____
TEAM LEADER _____

DISCLAIMER: THERE ARE NO REPRESENTATIONS OR WARRANTIES (EXPRESS OR IMPLIED) ABOUT THE ACCURACY OF THIS PRINT. THIS PRINT IS PROVIDED WITH NO CLAIM AS TO PRINT COMPLETENESS, TIMELINESS, ACCURACY OF CONTENT OR USEFULNESS. STATE LAW REQUIRES ANYONE DIGGING, GRADING OR EXCAVATING TO OBTAIN A PRIOR FIELD LOCATE OF ALL UTILITIES. THIS PRINT DOES NOT DISCHARGE THIS REQUIREMENT OR ANY OTHER REQUIREMENT. THE COMPANY AND ITS AFFILIATES ASSUME NO LEGAL RESPONSIBILITY OR LIABILITY FOR THE RECIPIENT'S USE (OR ANY OTHER PARTIES' USE) OF THE PRINT, INCLUDING THE RECIPIENT'S INTENDED PURPOSE IN USING THE PRINT. NO COMPANY EMPLOYEE OR OTHER PARTY HAS BEEN AUTHORIZED TO PROVIDE THIS PRINT FOR PLANNING OR ESTIMATING PURPOSES; RELY ON THIS PRINT AT YOUR OWN RISK. BY ACCEPTING THIS PRINT, THE RECIPIENT & ANY OTHER PARTY RECEIVING A COPY OF THE PRINT ACKNOWLEDGES AND AGREES TO THIS DISCLAIMER. For All Field Locates Call 811

THIS DOCUMENT IS XCEL ENERGY CONFIDENTIALS AND PROPRIETARY INFORMATION AND MAY NOT BE REPRODUCED IN WHOLE, OR IN PART, NOR MAY ANY OF THE INFORMATION CONTAINED HEREIN BE DISCLOSED WITHOUT THE CONSENT OF XCEL ENERGY. CONFIDENTIALS AND PROPRIETARY INFORMATION © 2019 XCEL ENERGY INC. | XCEL ENERGY IS REGISTERED TRADEMARK OF XCEL ENERGY INC