
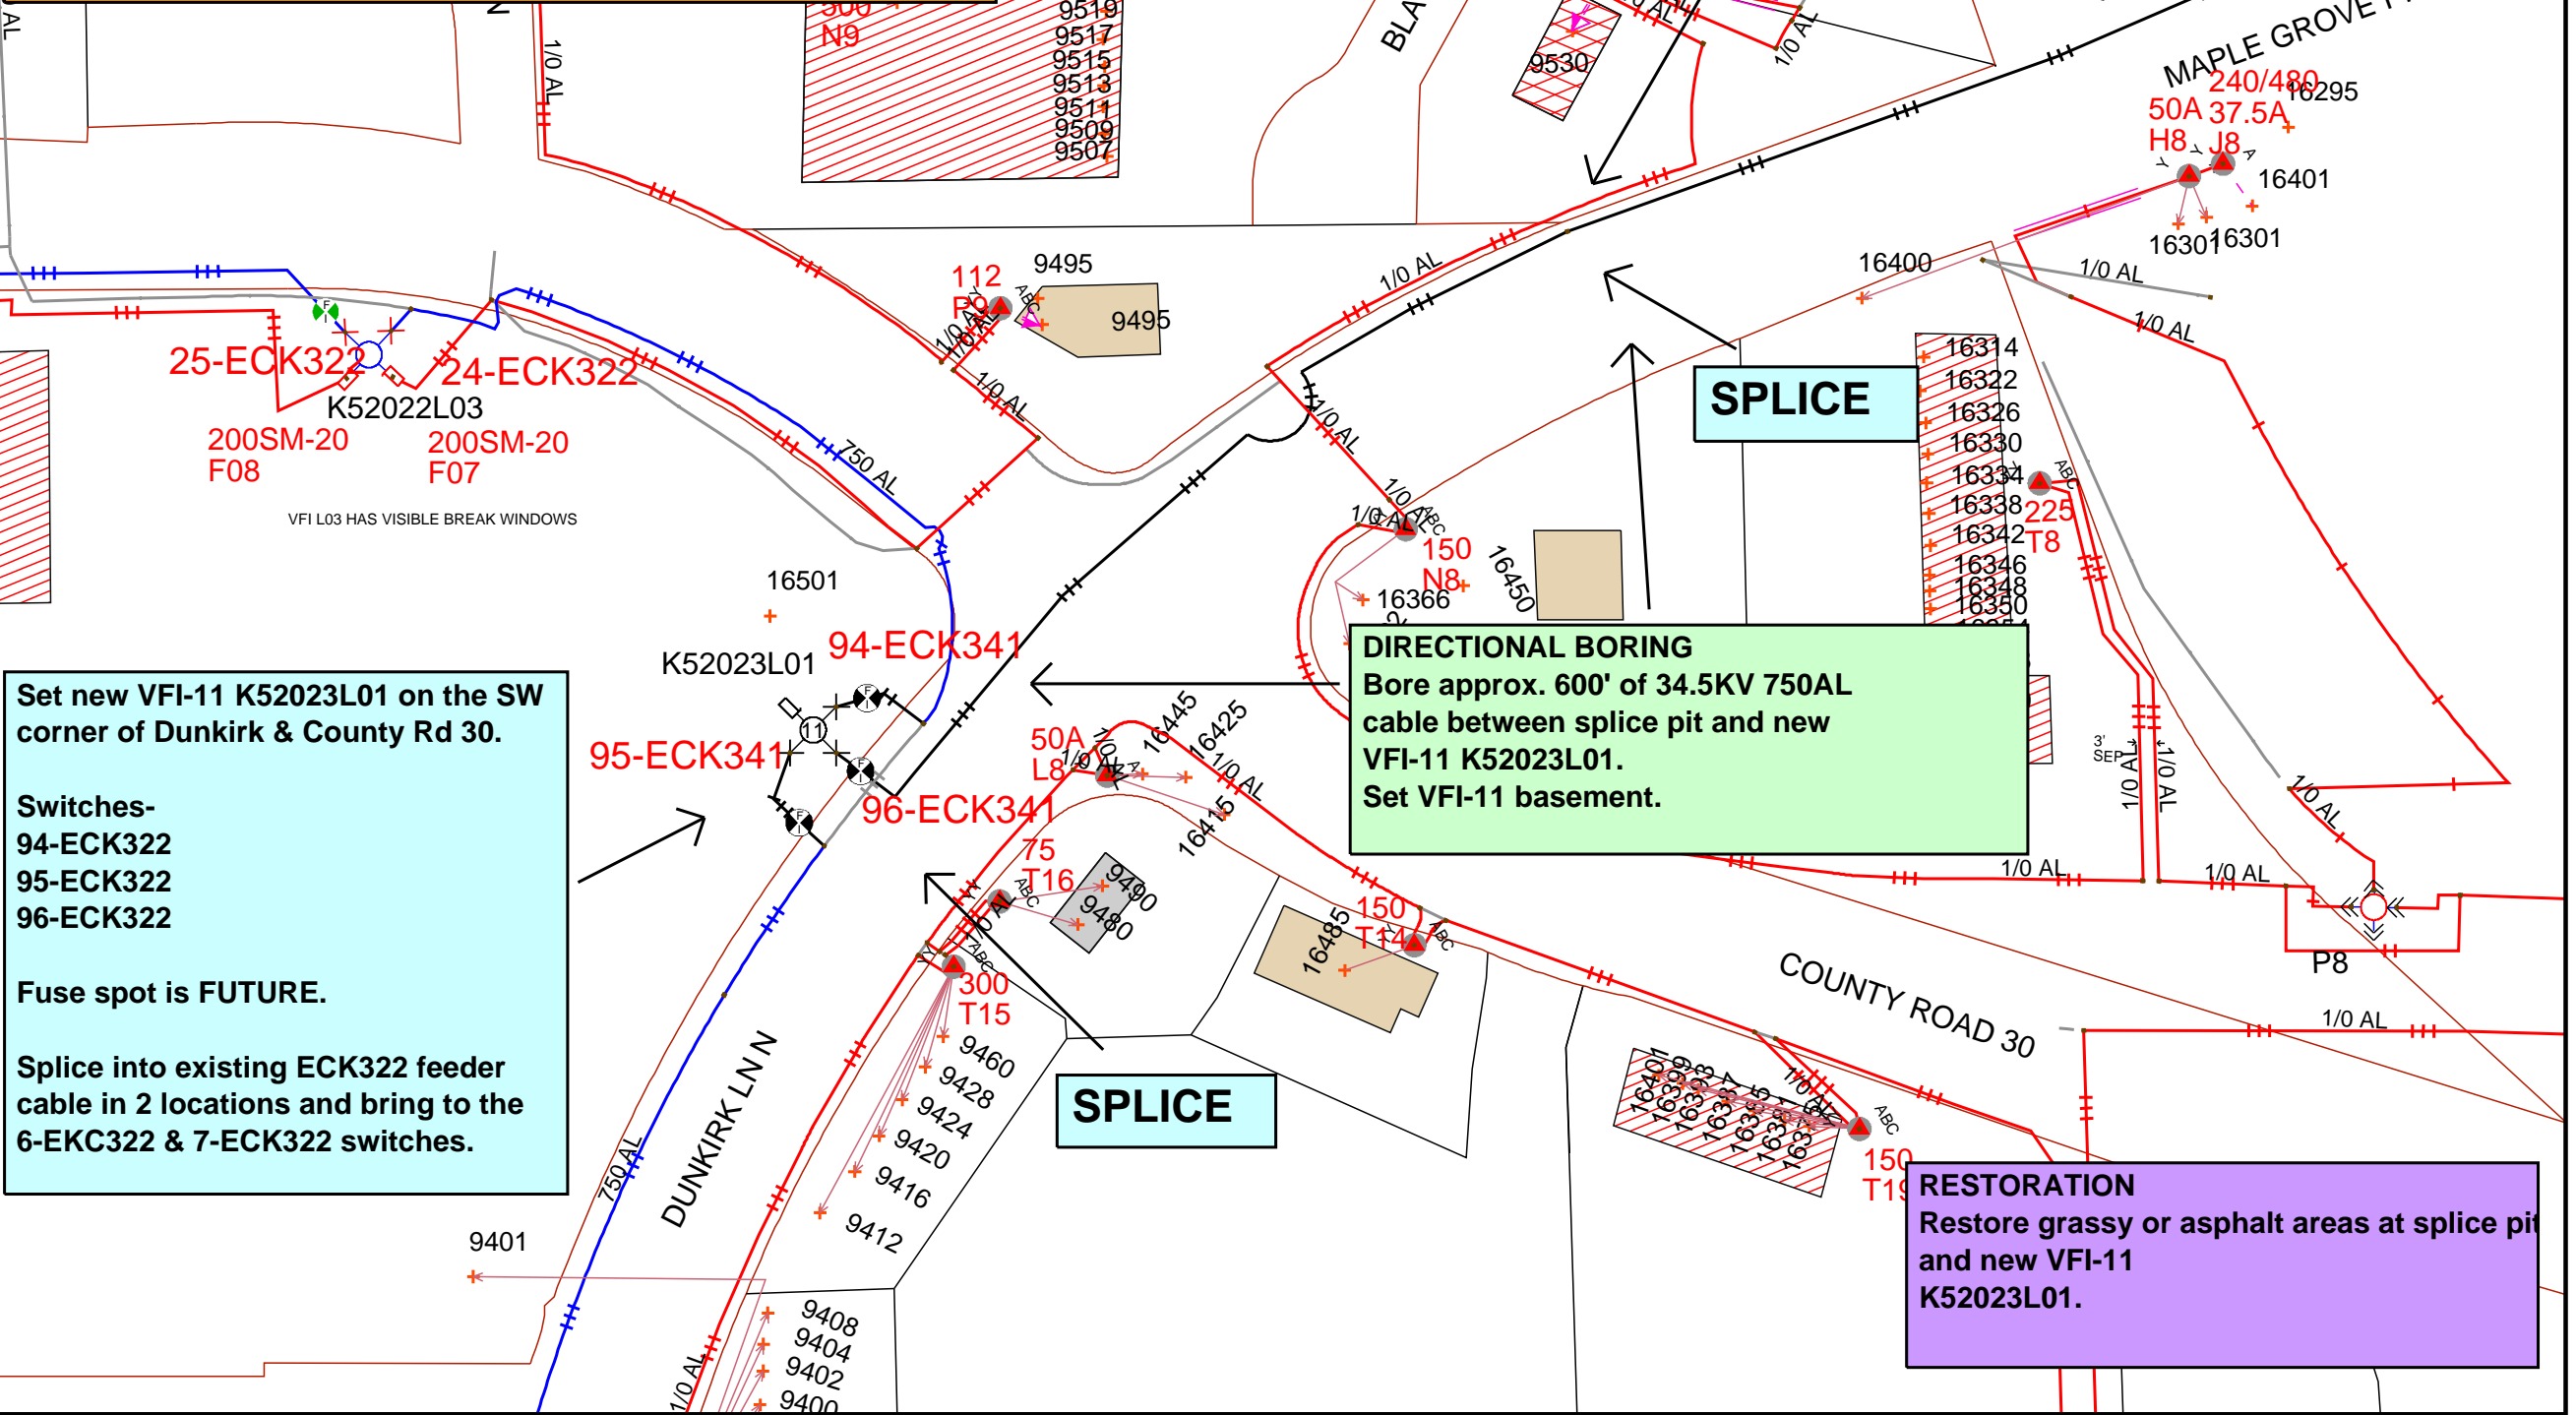


**ECK341 FEEDER INSTALL
DIRECTIONAL BORE FROM 99TH
& MAPLE GROVE PKWY TO 9401 DUNKIRK
LN.
ECK341-34.5KV
PG.4**

DIRECTIONAL BORE
Bore approx. 700' of 34.5KV 750AL cable
between splice pits.

SEE
PG. 3

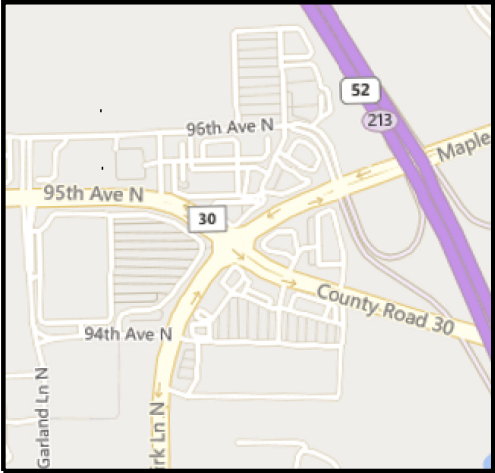

Set new VFI-11 K52023L01 on the SW corner of Dunkirk & County Rd 30.

Switches-
94-ECK322
95-ECK322
96-ECK322

Fuse spot is FUTURE.

Splice into existing ECK322 feeder cable in 2 locations and bring to the 6-ECK322 & 7-ECK322 switches.

DIRECTIONAL BORING
Bore approx. 600' of 34.5KV 750AL cable between splice pit and new VFI-11 K52023L01.
Set VFI-11 basement.

RESTORATION
Restore grassy or asphalt areas at splice pit and new VFI-11 K52023L01.

Work Order Information	
Service Request #	:
Design Number	: 000001002880
Designer/Planner ID	: pftj01
Designer/Planner Name	: Pfothenauer, John
Designer/Planner Ph #	: (612) 963-3804
Manager Approval	:

Joint Utility	
E:	G:
T:	C:

Design Location	
Division	: Maple Grove
County	: HENNEPIN
City	: MAPLE GROVE
Address	: 10150 FERNBROOK LN N
T: 119N	R: 22W S: 8
Map #	: K52023 Permit :

Electric	
Feeder: ECK341	Voltage: 34.5KV
Phase: ABC	Bkup Dev ID:


Gas	
System	: Pressure :
Size	: Material :
Dead End	:

Work Order # : 000106221620

Date: 05/19/2021

Sketch: 4 Of 4 Sketch Data

Scale: 1" equals 144'



CONSTRUCTION USE ONLY	
<input type="checkbox"/>	NO CHANGES (BUILT AS DESIGNED)
<input type="checkbox"/>	CHANGES MADE AS INDICATED (ALL URD MUST HAVE ACTUAL MEASUREMENTS FROM THE FIELD SITE)

RFO _____

FOREMAN _____ DATE _____

TEAM LEADER _____

DISCLAIMER: THERE ARE NO REPRESENTATIONS OR WARRANTIES (EXPRESS OR IMPLIED) ABOUT THE ACCURACY OF THIS PRINT. THIS PRINT IS PROVIDED WITH NO CLAIM AS TO PRINT COMPLETENESS, TIMELINESS, ACCURACY OF CONTENT OR USEFULNESS. STATE LAW REQUIRES ANYONE DIGGING, GRADING OR EXCAVATING TO OBTAIN A PRIOR FIELD LOCATE OF ALL UTILITIES. THIS PRINT DOES NOT DISCHARGE THIS REQUIREMENT OR ANY OTHER REQUIREMENT. THE COMPANY AND ITS AFFILIATES ASSUME NO LEGAL RESPONSIBILITY OR LIABILITY FOR THE RECIPIENT'S USE (OR ANY OTHER PARTIES' USE) OF THE PRINT, INCLUDING THE RECIPIENT'S INTENDED PURPOSE IN USING THE PRINT. NO COMPANY EMPLOYEE OR OTHER PARTY HAS BEEN AUTHORIZED TO PROVIDE THIS PRINT FOR PLANNING OR ESTIMATING PURPOSES; RELY ON THIS PRINT AT YOUR OWN RISK. BY ACCEPTING THIS PRINT, THE RECIPIENT & ANY OTHER PARTY RECEIVING A COPY OF THE PRINT ACKNOWLEDGES AND AGREES TO THIS DISCLAIMER. For All Field Locates Call 811

THIS DOCUMENT IS XCEL ENERGY CONFIDENTIALS AND PROPRIETARY INFORMATION AND MAY NOT BE REPRODUCED IN WHOLE, OR IN PART, NOR MAY ANY OF THE INFORMATION CONTAINED HEREIN BE DISCLOSED WITHOUT THE CONSENT OF XCEL ENERGY. CONFIDENTIALS AND PROPRIETARY INFORMATION © 2019 XCEL ENERGY INC. | XCEL ENERGY IS REGISTERED TRADEMARK OF XCEL ENERGY INC