Escalated Cable Replacement
9920 96th Avenue N, Maple Grove
Feeder. OSS073/A/7.9Kva

Directional Bore. Bore in 1350' of #2AL 1P Cable from J1 to D1 and D1 to E1
Replace Basements J1, D1 and E1 Terminations. 3 termination at J1, D1 and E1

Restorations.

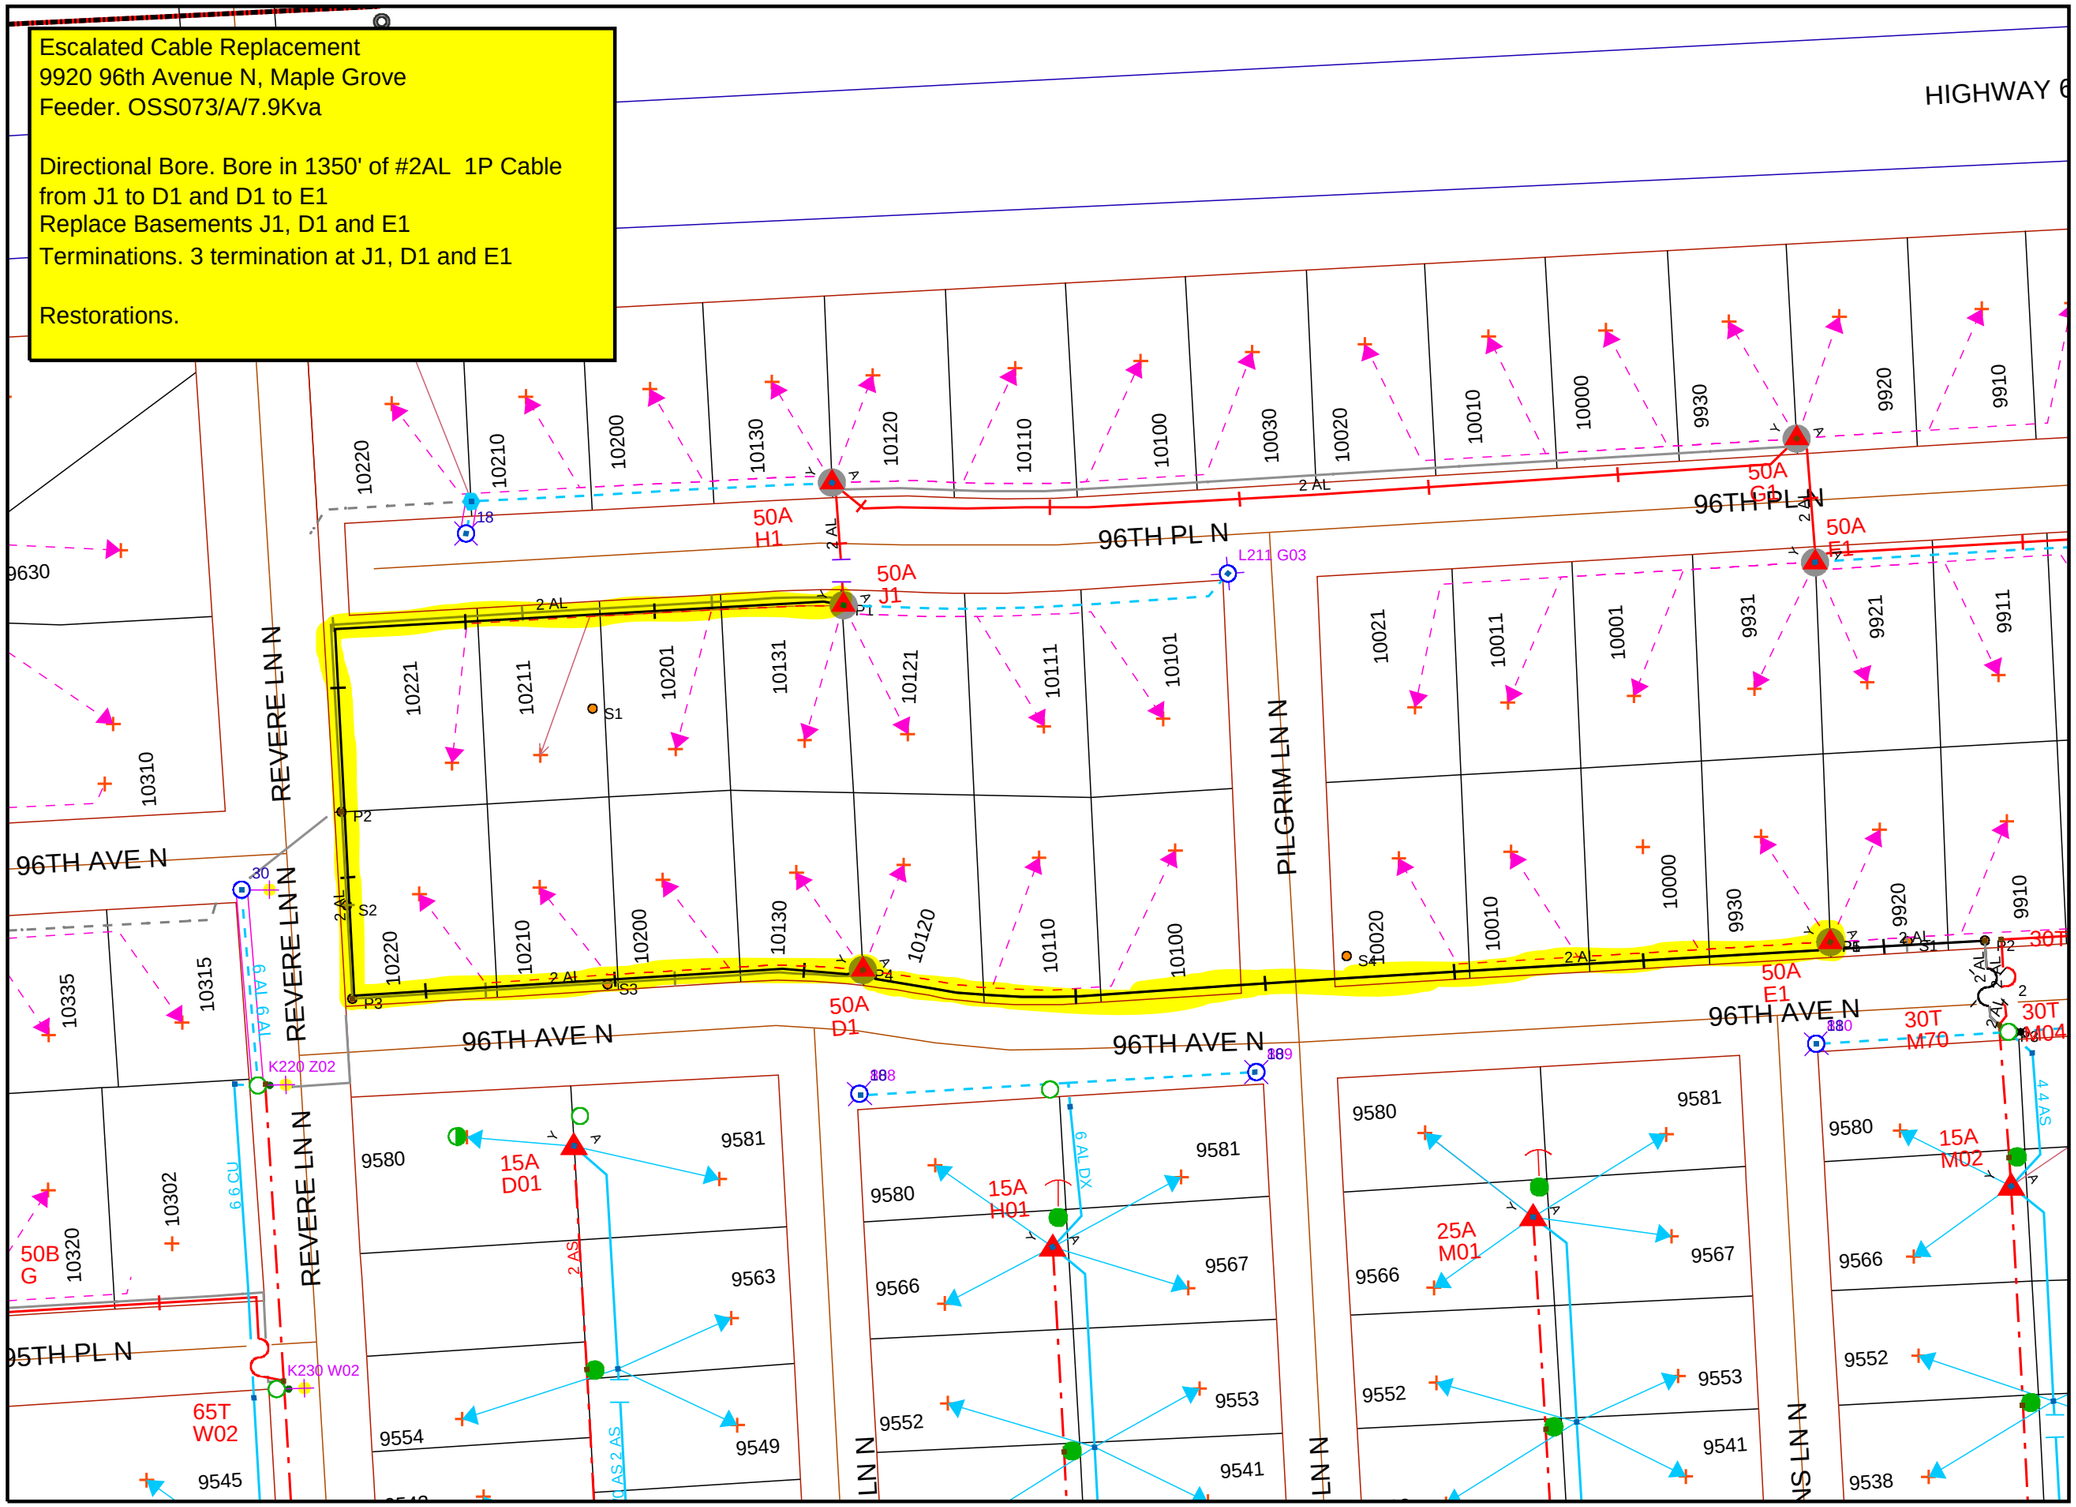

Haile Werke
O (651)-265-7028
C (651)-246-6331

Work Order Information		
Service Request #	:	
Design Number	:	000000907733
Designer/Planner ID	:	235036
Designer/Planner Name	:	Werke, Haile
Designer/Planner Ph #	:	(651) 265-7028
Manager Approval	:	

Joint Utility	
E:	G:
T:	C:

Design Location		
Division	:	Minneapolis
County	:	Hennepin
City	:	Maple Grove
Address	:	9920 96th Avenue N
T: 119N R: 22W S: 12		
Map # : L52011		Permit :

Electric	
Feeder: See Notes	Voltage: See Notes
Phase: See Notes	Bkup Dev ID:

Gas	
System :	Pressure :
Size :	Material :
Dead End :	
Work Order # :	

Date: 01/31/2020
Sketch: # Of # Sketch Data
Scale: 1" equals 100'

Xcel Energy

CONSTRUCTION USE ONLY

- ☐ NO CHANGES (BUILT AS DESIGNED)
- ☐ CHANGES MADE AS INDICATED (ALL URD MUST HAVE ACTUAL MEASUREMENTS FROM THE FIELD SITE)

RFO _____
FOREMAN _____ DATE _____
TEAM LEADER _____

DISCLAIMER: THERE ARE NO REPRESENTATIONS OR WARRANTIES (EXPRESS OR IMPLIED) ABOUT THE ACCURACY OF THIS PRINT. THIS PRINT IS PROVIDED WITH NO CLAIM AS TO PRINT COMPLETENESS, TIMELINESS, ACCURACY OF CONTENT OR USEFULNESS. STATE LAW REQUIRES ANYONE DIGGING, GRADING OR EXCAVATING TO OBTAIN A PRIOR FIELD LOCATE OF ALL UTILITIES; THIS PRINT DOES NOT DISCHARGE THIS REQUIREMENT OR ANY OTHER REQUIREMENT. THE COMPANY AND ITS AFFILIATES ASSUME NO LEGAL RESPONSIBILITY OR LIABILITY FOR THE RECIPIENT'S USE (OR ANY OTHER PARTIES' USE) OF THE PRINT, INCLUDING THE RECIPIENTS INTENDED PURPOSE IN USING THE PRINT. NO COMPANY EMPLOYEE OR OTHER PARTY HAS BEEN AUTHORIZED TO PROVIDE THIS PRINT FOR PLANNING OR ESTIMATING PURPOSES; RELY ON THIS PRINT AT YOUR OWN RISK. BY ACCEPTING THIS PRINT, THE RECIPIENT & ANY OTHER PARTY RECEIVING A COPY OF THE PRINT ACKNOWLEDGES AND AGREES TO THIS DISCLAIMER. For All Field Locates Call 811