


WORK BEING DONE TO GAIN CLEARANCE FOR AGIS/FAN ATTACHMENT
 17300 TERRITORIAL RD MAPLE GROVE, MN 55369
 FEEDER: ECK322, ABC, 34.5KV
 MN_RLY_1299
 FAN ID: 207535
 COMMS WO: 107441222

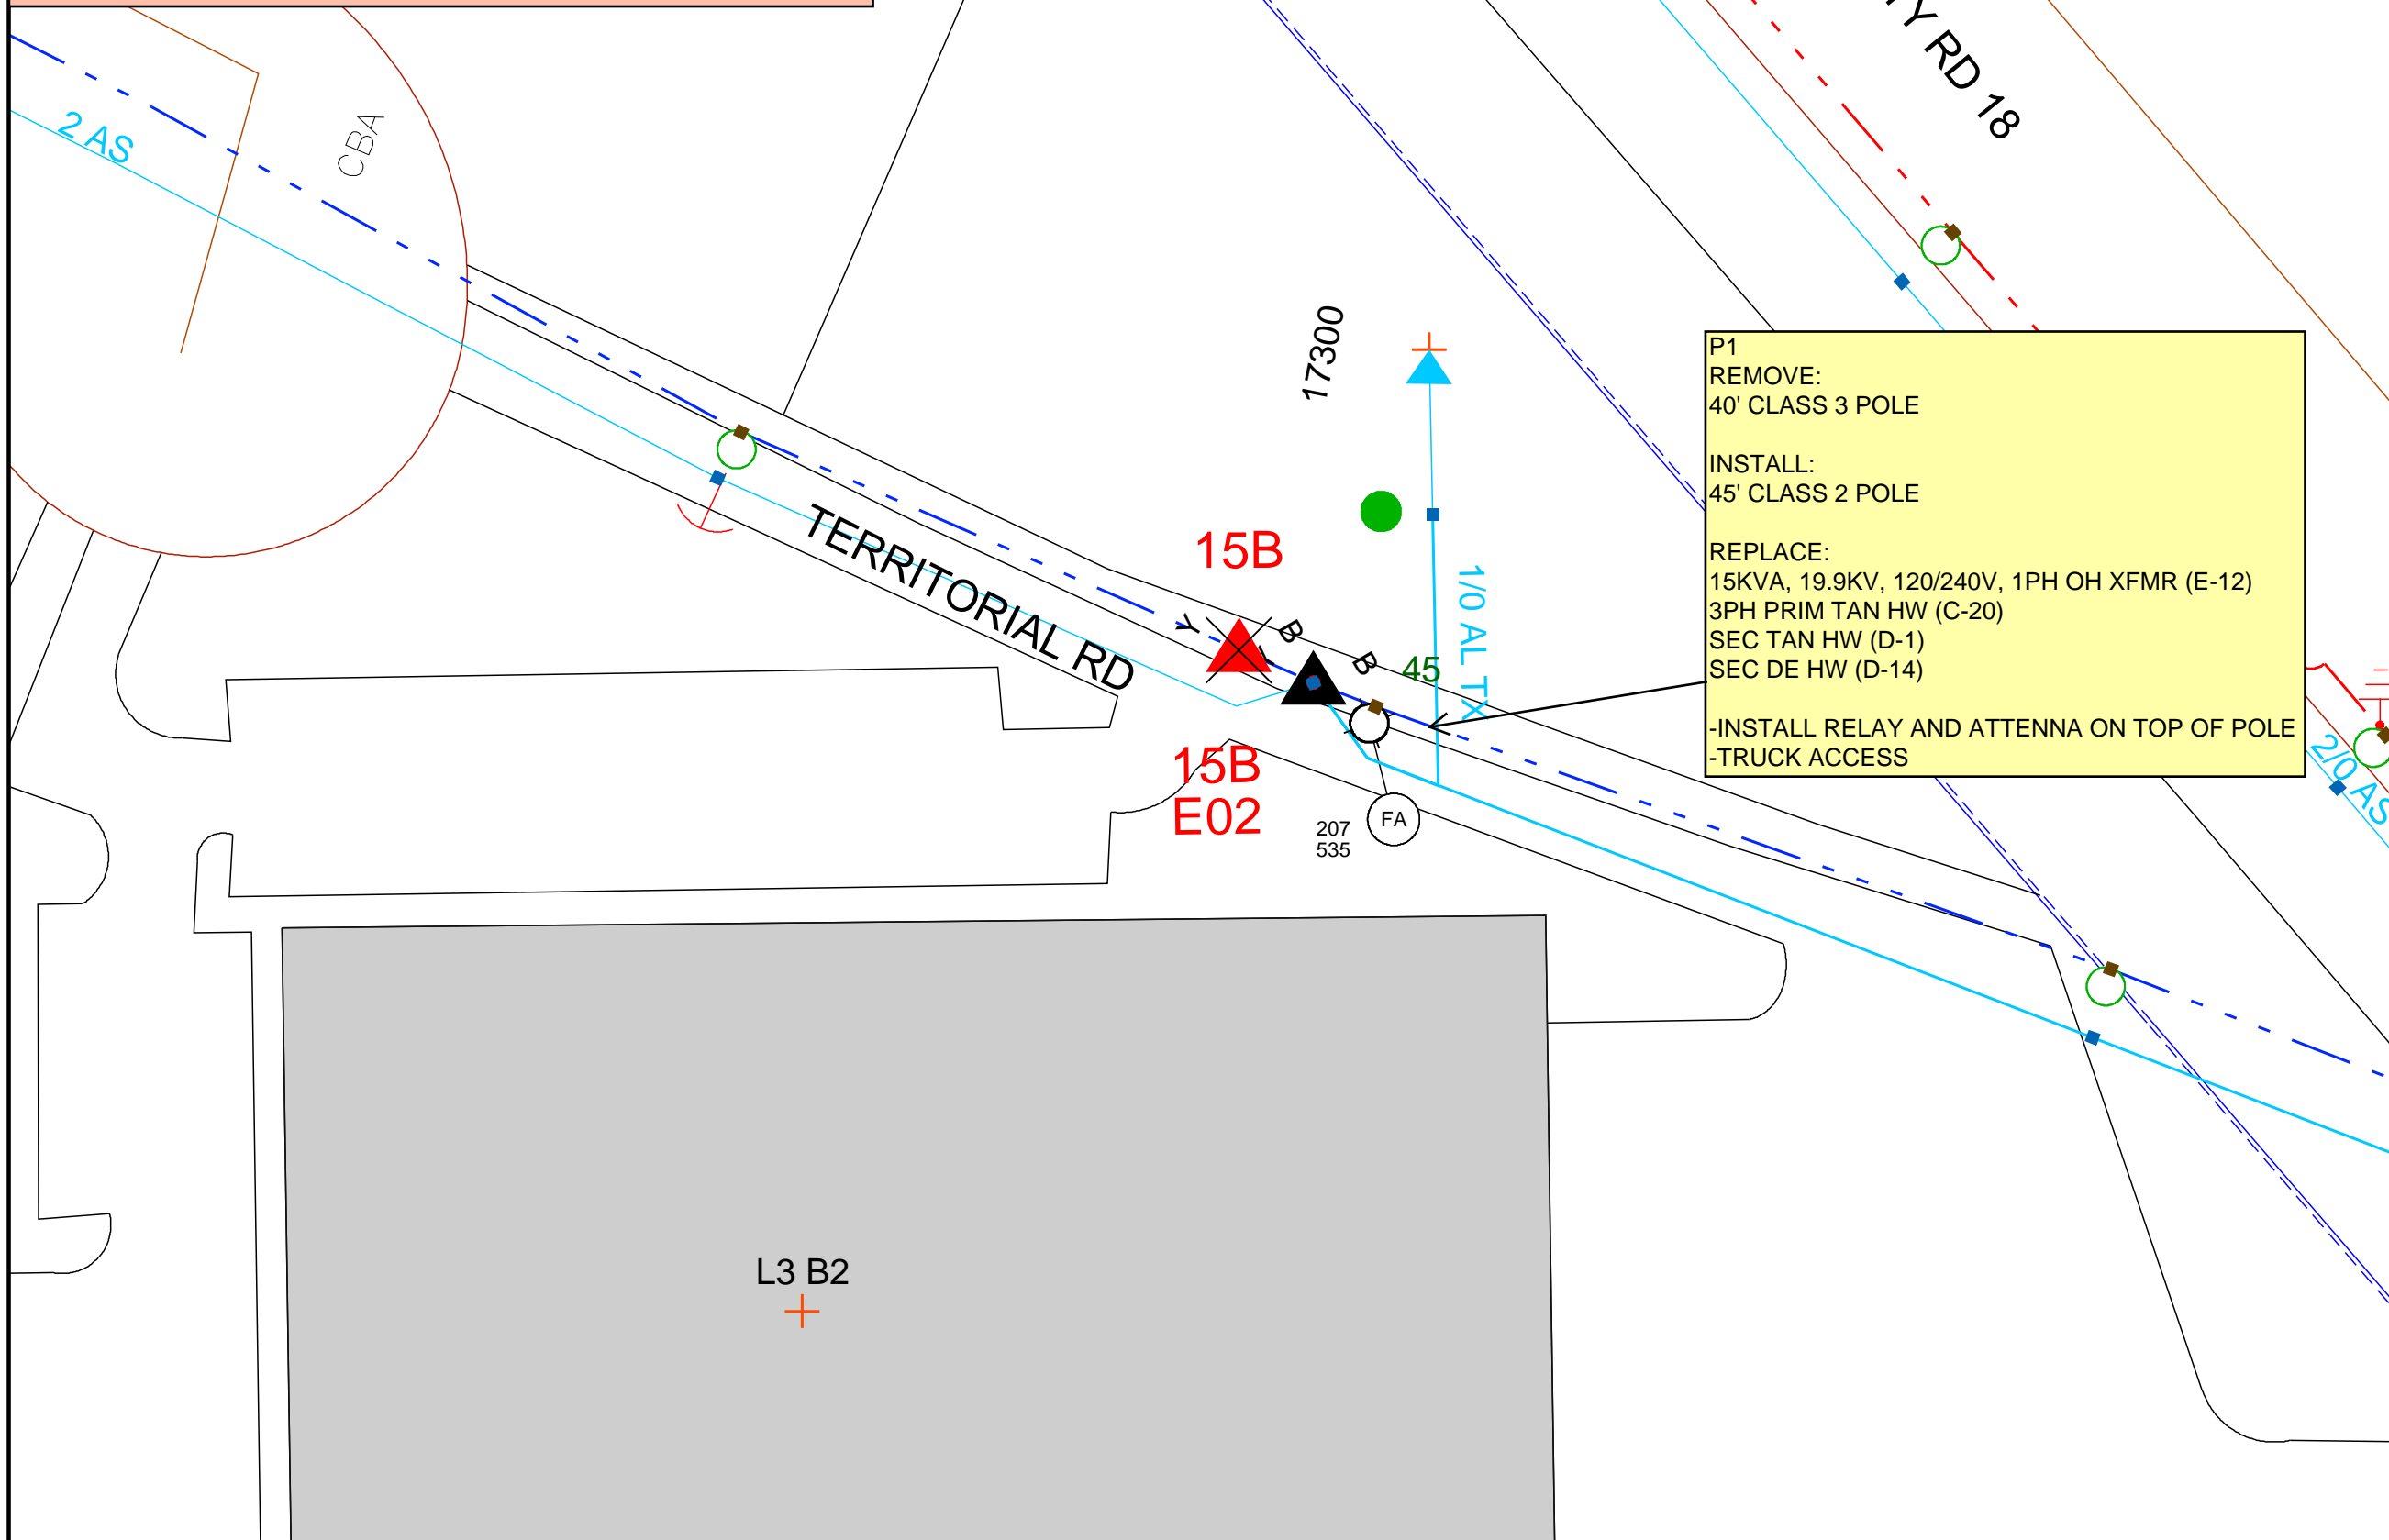


P1
 REMOVE:
 40' CLASS 3 POLE

 INSTALL:
 45' CLASS 2 POLE

 REPLACE:
 15KVA, 19.9KV, 120/240V, 1PH OH XFMR (E-12)
 3PH PRIM TAN HW (C-20)
 SEC TAN HW (D-1)
 SEC DE HW (D-14)

 -INSTALL RELAY AND ANTENNA ON TOP OF POLE
 -TRUCK ACCESS

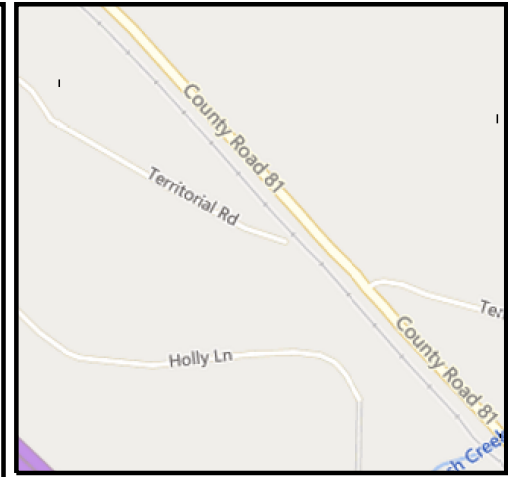

JORDAN ERICKSON
 (612) 256-8020
 JORDAN.D.ERICKSON@XCELENERGY.COM

Work Order Information	
Service Request #	: 12979044
Design Number	: 000001068040
Designer/Planner ID	: 244627
Designer/Planner Name	: Erickson, Jordan
Designer/Planner Ph #	: (612) 256-8020
Manager Approval	: _____

Joint Utility	
E: NA	G: NA
T: NA	C: NA

Design Location	
Division	: Maple Grove
County	: Hennepin
City	: Dayton
Address	: 17300 Territorial Rd
T: 120N	R: 22W S: 32
Map #	: K51062 Permit : MAPLE GROVE

Electric	
Feeder: ECK322	Voltage: 34.5KV
Phase: ABC	Bkup Dev ID: NA

Gas	
System	: NA Pressure : NA
Size	: NA Material : NA
Dead End	: NA

Work Order # :
 Date: 03/17/2022
 Sketch: 1 Of 1 Sketch Data
 Scale: 1" equals 50'



CONSTRUCTION USE ONLY
 NO CHANGES (BUILT AS DESIGNED)
 CHANGES MADE AS INDICATED
 (ALL URD MUST HAVE ACTUAL MEASUREMENTS FROM THE FIELD SITE)

RFO _____
 FOREMAN _____ DATE _____
 TEAM LEADER _____

DISCLAIMER: THERE ARE NO REPRESENTATIONS OR WARRANTIES (EXPRESS OR IMPLIED) ABOUT THE ACCURACY OF THIS PRINT. THIS PRINT IS PROVIDED WITH NO CLAIM AS TO PRINT COMPLETENESS, TIMELINESS, ACCURACY OF CONTENT OR USEFULNESS. STATE LAW REQUIRES ANYONE DIGGING, GRADING OR EXCAVATING TO OBTAIN A PRIOR FIELD LOCATE OF ALL UTILITIES. THIS PRINT DOES NOT DISCHARGE THIS REQUIREMENT OR ANY OTHER REQUIREMENT. THE COMPANY AND ITS AFFILIATES ASSUME NO LEGAL RESPONSIBILITY OR LIABILITY FOR THE RECIPIENT'S USE (OR ANY OTHER PARTIES' USE) OF THE PRINT, INCLUDING THE RECIPIENT'S INTENDED PURPOSE IN USING THE PRINT. NO COMPANY EMPLOYEE OR OTHER PARTY HAS BEEN AUTHORIZED TO PROVIDE THIS PRINT FOR PLANNING OR ESTIMATING PURPOSES; RELY ON THIS PRINT AT YOUR OWN RISK. BY ACCEPTING THIS PRINT, THE RECIPIENT & ANY OTHER PARTY RECEIVING A COPY OF THE PRINT ACKNOWLEDGES AND AGREES TO THIS DISCLAIMER. For All Field Locates Call 811
 THIS DOCUMENT IS XCEL ENERGY CONFIDENTIALS AND PROPRIETARY INFORMATION AND MAY NOT BE REPRODUCED IN WHOLE, OR IN PART, NOR MAY ANY OF THE INFORMATION CONTAINED HEREIN BE DISCLOSED WITHOUT THE CONSENT OF XCEL ENERGY. CONFIDENTIALS AND PROPRIETARY INFORMATION © 2019 XCEL ENERGY INC. | XCEL ENERGY IS REGISTERED TRADEMARK OF XCEL ENERGY INC



17300 Territorial Rd,
Maple Grove, MN 55369

81

Territorial Rd

Territorial Rd

Transformer &
Pole to be
replaced

