


**Forced Relo**  
**7890 Main St N.**  
**Maple Grove, MN 55369**  
**JB0001042063**  
**Node: MNMPGR046**  
**Legacy: D-B3-1**

**CONTACT INFO:**  
**USI Contact: Anthony**  
**612-434-5149**  
**Alins@USI-Universal.com**  
**Comcast Contact: McClay**  
**651-925-6372**

Green Lin = New Underground Placement  
 Yellow Line = Existing Conduit  
 Blue Line = Aerial Placement  
 New Fiber Vault  
 Existing Fiber Vault  
 New Pedestal  
 Existing Pedestal

**\*Construction Notes\***  
 Remove existing vault to make room for future driveway in NE corner of parking lot. Vault will be replaced with a 10" ped near the retaining wall. Need to expose existing coax duct back to trees, dig trench from vault to new ped location, and dig trench from trees around wall to new ped location. Please leave duct and coupling onsite for splicer. Splicer will extend coax from vault location to new ped, and swing existing coax around to new ped location. UG will return for backfill/resto.

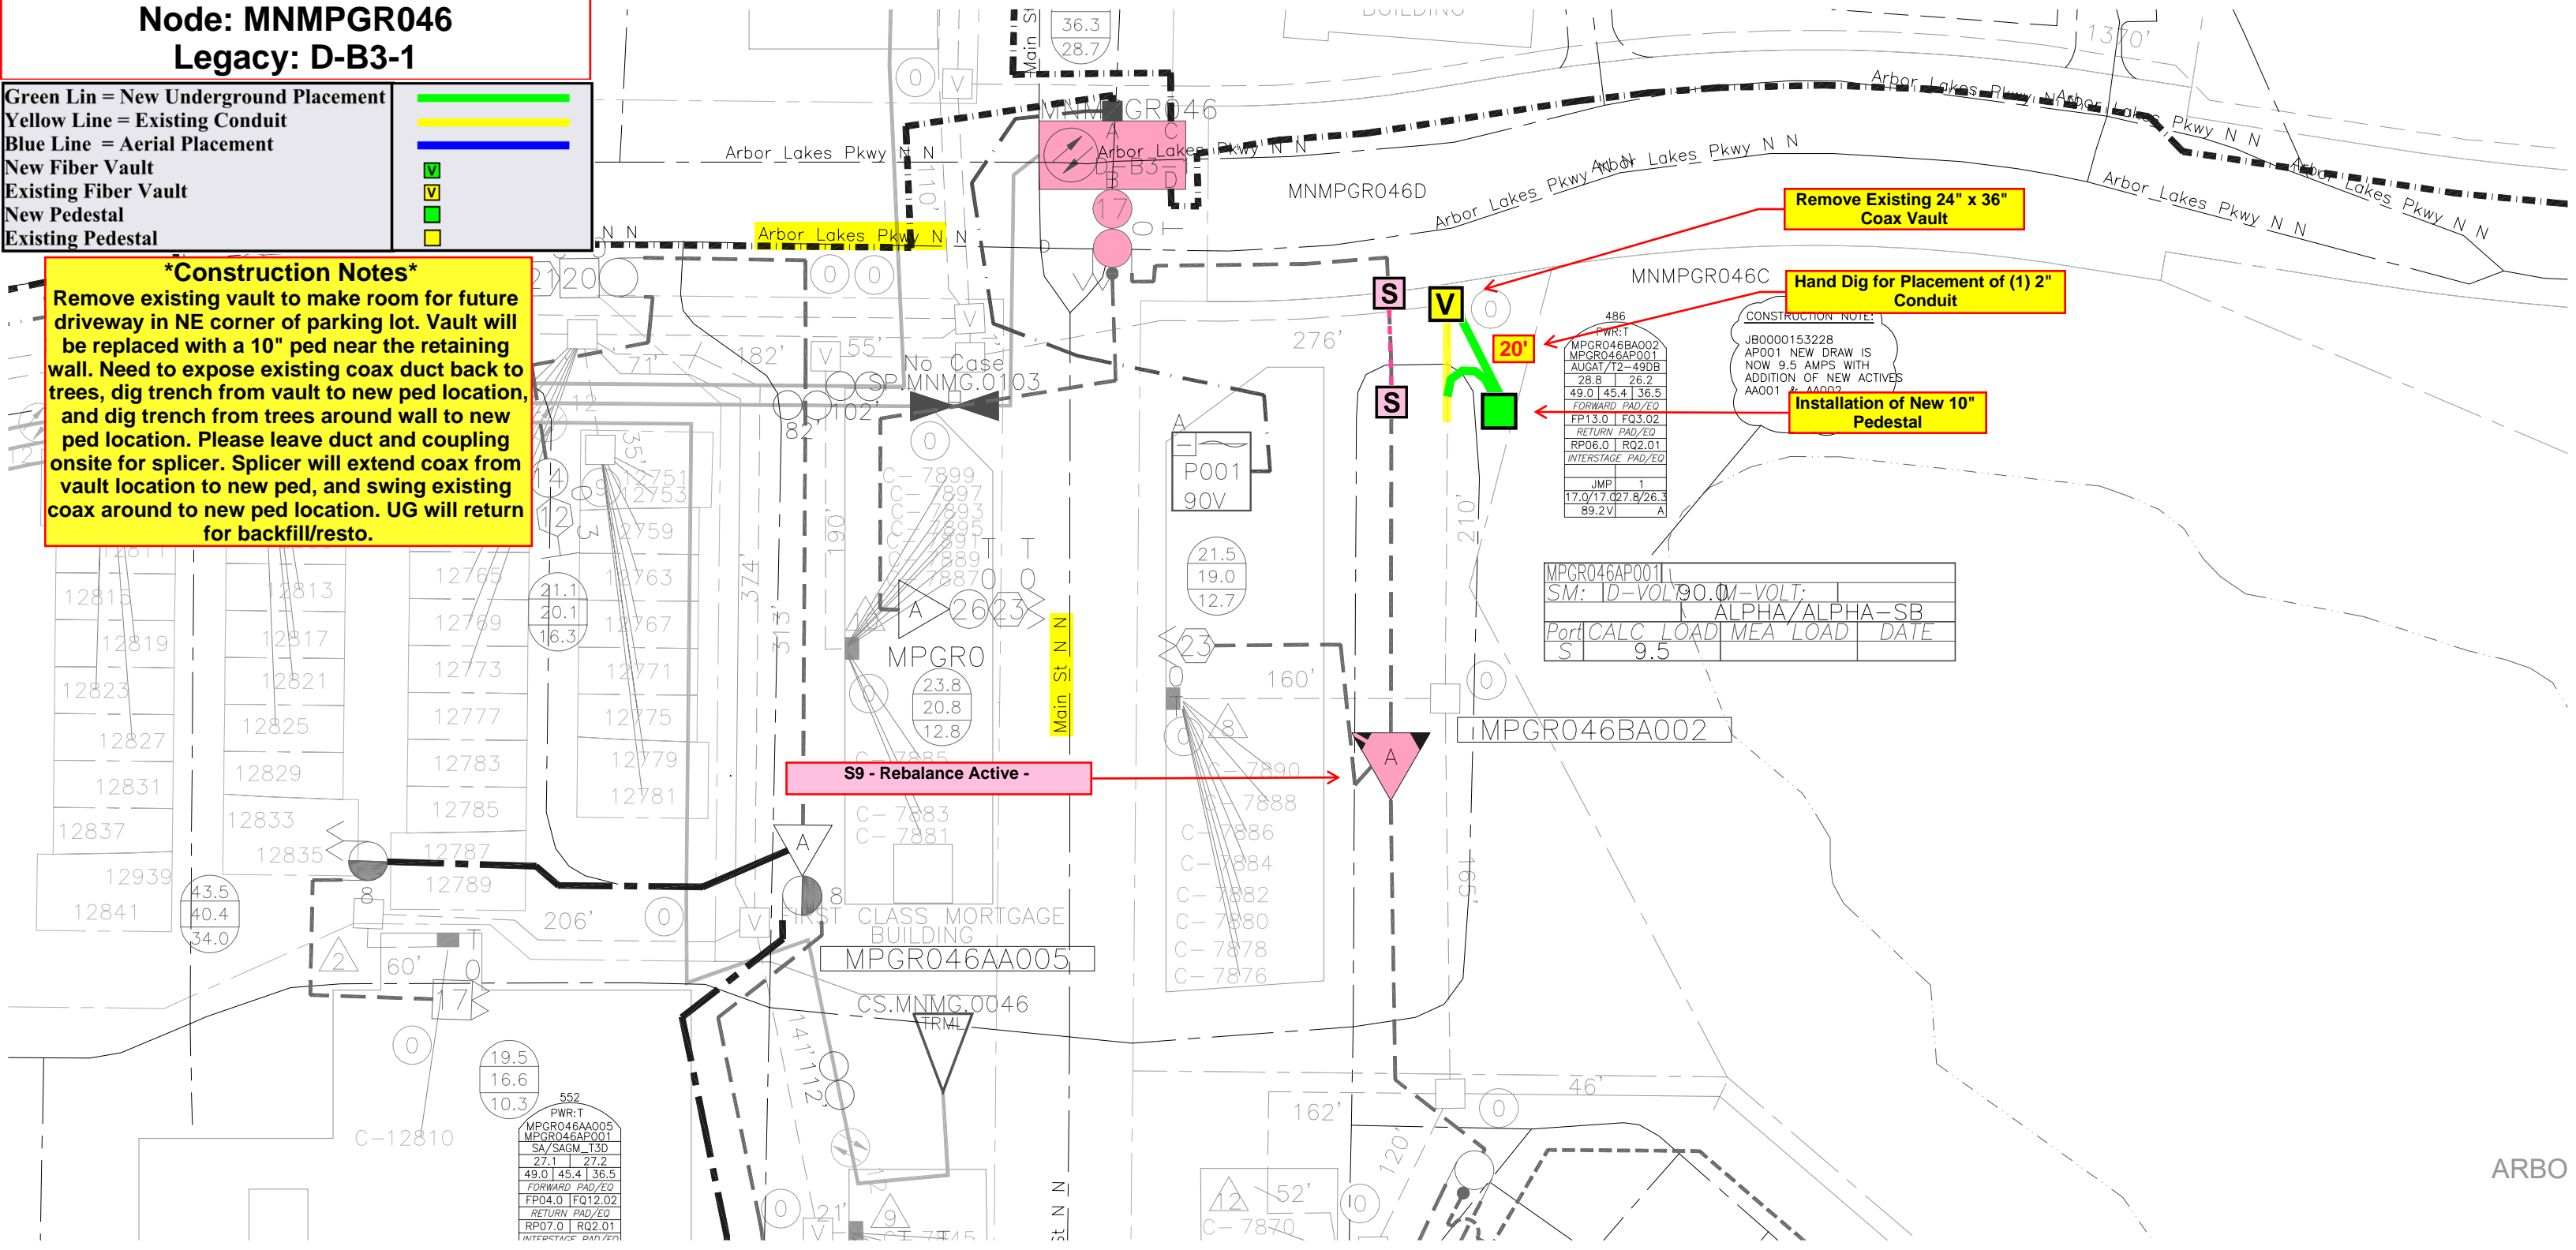

486		
PWR:T		
MPCR046BA002		
MPCR046AP001		
AUGAT/T2-49DB		
28.8	26.2	
49.0	45.4	36.5
FORWARD PAD/EQ		
FP13.0	FQ3.02	
RETURN PAD/EQ		
RP06.0	RQ2.01	
INTERSTAGE PAD/EQ		
JMP 1		
17.0/17.0	27.8/26.3	
89.2V		A

CONSTRUCTION NOTE:  
 JB0000153228  
 AP001 NEW DRAW IS  
 NOW 9.5 AMPS WITH  
 ADDITION OF NEW ACTIVES  
 AA001 & AA002

MPCR046AP001			
SM: ID-VOL: 90.0M-VOLT:			
ALPHA/ALPHA-SB			
Port	CALC	LOAD	MEAS
S	9.5		DATE

552		
PWR:T		
MPCR046AA005		
MPCR046AP001		
SA/SAGM_T3D		
27.1	27.2	
49.0	45.4	36.5
FORWARD PAD/EQ		
FP04.0	FQ12.02	
RETURN PAD/EQ		
RP07.0	RQ2.01	
INTERSTAGE PAD/EQ		

ARBO