





- GENERAL NOTES:**
1. TEMPORARY CONVEYANCE ALIGNMENT IS SHOWN ON THIS PLAN. ALTERNATIVE ALIGNMENTS MAY BE USED IF ACCEPTABLE TO CAR AT NO ADDITIONAL COST TO MCES.
 2. BURY TEMPORARY CONVEYANCE PIPES UNDER ALL DRIVEWAYS & STREET CROSSINGS UNLESS NOTED OTHERWISE.
 3. DIRECTIONALLY DRILLED TEMPORARY CONVEYANCE PIPES SHALL BE FILLED WITH CLSM AFTER TEMPORARY CONVEYANCE IS COMPLETED.
 4. PROVIDE CAR 6 WEEKS NOTICE BEFORE TAKING ANY BILLING METERS OFFLINE. MCES WILL INSTALL TEMPORARY BILLING METERS.
 5. TEMP CONVEY LOCAL/CITY SANITARY FLOWS AS NEEDED TO PERFORM THE WORK.
 6. RESTORE ALL DAMAGED SURFACES (PAVEMENT & LANDSCAPING) IN KIND ONCE TEMP CONVEYANCE SYSTEM IS REMOVED. SEE CP SHEETS FOR PAVEMENT SECTION DETAILS.
 7. PROVIDE & MAINTAIN INLET PROTECTION PER DETAIL 5/CJ5.

- KEYNOTES:**
1. DIRECTIONALLY DRILL TEMPORARY CONVEYANCE PIPE UNDER ROAD CROSSING.
 2. JACK STEEL CASING PIPE UNDER RAILROAD PER BNSF REQUIREMENTS AND PERMIT FOR PROJECT. SEE SHEET CJ14.
 3. SEE CU5 FOR MH 24 & MH23A TEMPORARY CONVEYANCE DISCHARGE LOCATION.
 4. SHALLOW BURY TEMP CONVEYANCE PIPES UNDER ROAD. COVER WITH A TEMP BITUMINOUS PATCH.
 5. TEMP CONVEYANCE - DRIVEWAY CROSSING.

-  MAJOR PUMPING LOCATION
-  CITY SANITARY SEWER CONNECTION

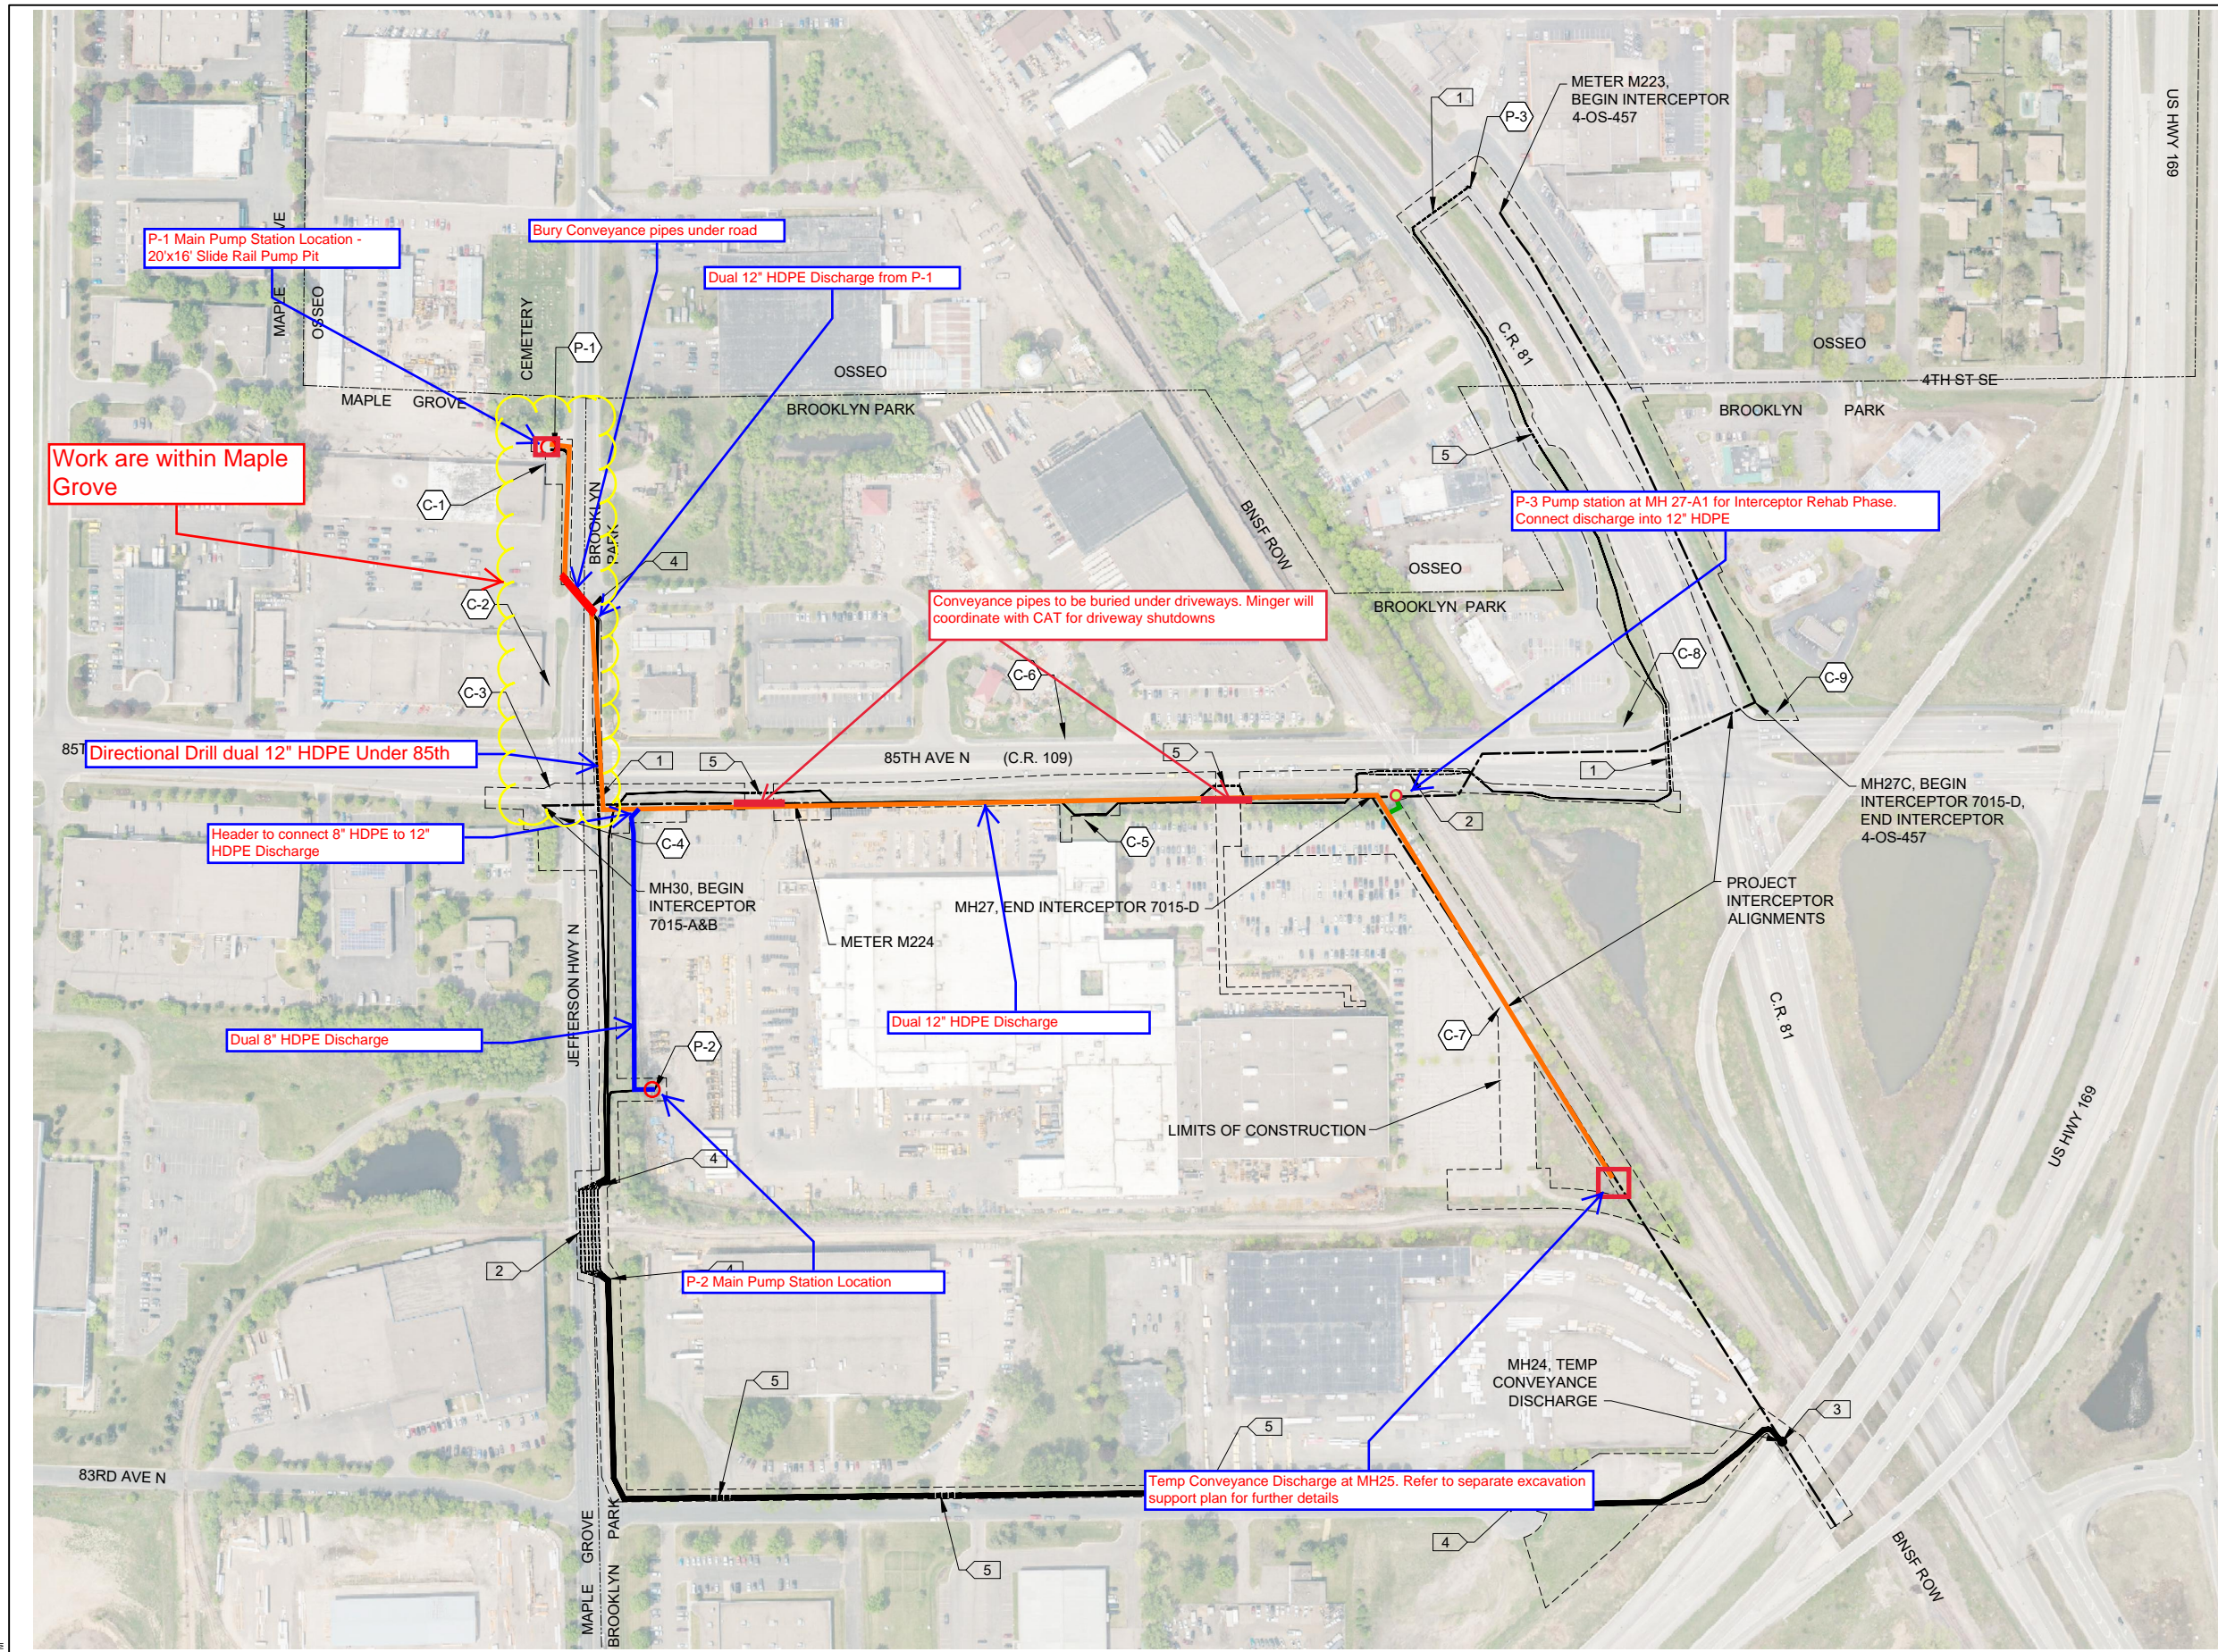

J:\2019\20190012.D6\CAD\809361\SHEETS\CU001.DWG
 PLOTTED: 1/7/2021 9:00:42 AM
 MODIFIED: 9/29/2020 4:26:16 PM

NO	DATE	BY	REVISIONS	REMARKS
1	01/06/21	ARS	ISSUED FOR BIDDING	

DESIGNED	ARS	I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DAILY LICENSED PROFESSIONAL UNDER THE LAWS OF THE STATE OF MINNESOTA.
DRAWN	JUC	
CHECKED	ARS	
DATE	01/06/21	
REG NO	52793	



PROJECT: 809361
 FILE NAME: CU001

PROJECT: 809361
 FILE NAME: CU001
 BROOKLYN PARK & OSSEO INTERCEPTOR REHABILITATION
TEMP CONVEYANCE
CU1
 8 of 63