

9357 TEWSBURY BEND
 ID: 40491963
 POI: J230 U01
 ECK322/C/19.92KV


TASK 1: DIRECTIONAL BORE
 BORE IN 65' OF 4/0 AL UG TRIPLEX CABLE P1 TO P2

TASK 2: TERMINATION
 TERMINATE AT P1 AND P2

TASK 3: RESTORATION

TASK 4: REMOVE TEMP SERVICE

NOTE: ABANDON EXISTING SVC CABLE IN PLACE
 REMOVE LANDSCAPE AT METER AND TRANSFORMER

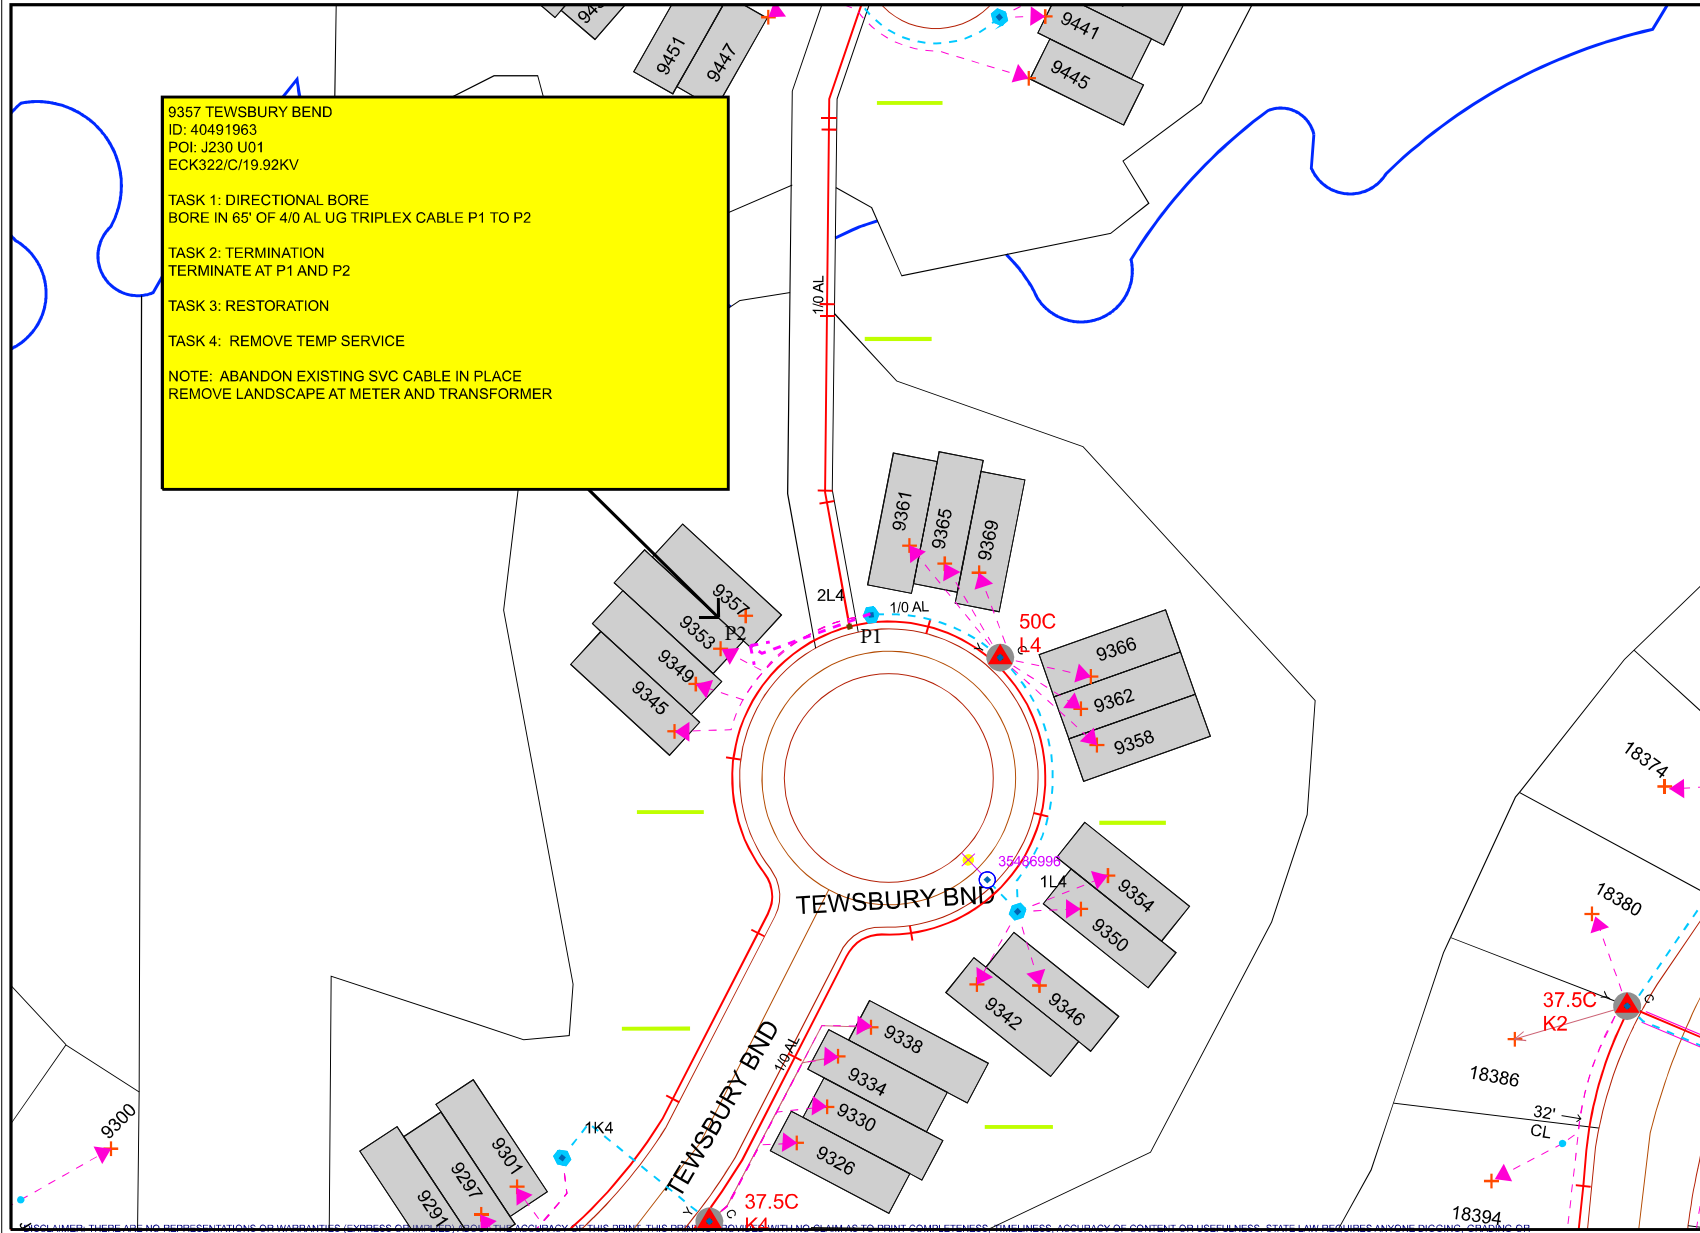

Work Order Information	
Service Request #	: 000013733873
Design Number	: 00001122309
Designer/Planner ID	: 243322
Designer/Planner Name	: DEBORAH GROSKO
Designer/Planner Ph #	: (816) 414-1113
Manager Approval	:
Joint Utility	
E:	G:
T:	C:
Design Location	
Division	: Maple Grove
County	: Hennepin
City	: Maple Grove
Address	: 9357 Tewsbury Bend
T: 119N	R: 22W S: 7
Map #	: J52030 Permit :
Electric	
Feeder: ECK322	Voltage: 19.92kV
Phase: C	Bkup Dev ID:
Gas	
System	: Pressure :
Size	: Material :
Dead End	:
Work Order #	: 00000109489546
Date:	04/26/2023
Sketch:	1 Of 1 Sketch Data
Scale:	1" equals 83'

CONSTRUCTION USE ONLY

NO CHANGES (BUILT AS DESIGNED)
 CHANGES MADE AS INDICATED
 (ALL URD MUST HAVE ACTUAL MEASUREMENTS FROM THE FIELD SITE)

RFO: _____
 FOREMAN: _____ DATE: _____
 TEAM LEADER: _____

EXCAVATING TO OBTAIN A PRIOR FIELD LOCATE OF ALL UTILITIES; THIS PRINT DOES NOT DISCHARGE THIS REQUIREMENT OR ANY OTHER REQUIREMENT. THE COMPANY AND ITS AFFILIATES ASSUME NO LEGAL RESPONSIBILITY OR LIABILITY FOR THE RECIPIENT'S USE (OR ANY OTHER PARTIES' USE) OF THE PRINT, INCLUDING THE RECIPIENTS INTENDED PURPOSE IN USING THE PRINT. NO COMPANY EMPLOYEE OR OTHER PARTY HAS BEEN AUTHORIZED TO PROVIDE THIS PRINT FOR PLANNING OR ESTIMATING PURPOSES; RELY ON THIS PRINT AT YOUR OWN RISK. BY ACCEPTING THIS PRINT, THE RECIPIENT & ANY OTHER PARTY RECEIVING A COPY OF THE PRINT ACKNOWLEDGES AND AGREES TO THIS DISCLAIMER. For All Field Locates Call 811