


Proactive - T2A - NONE - MNMGD09A00 1x2 (MNMPGRN10501 1x1)_Housing Swap No Amp Upgrade 13449 Territorial Rd Maple Grove MN JB0001399500
Node: MNMPGRN10501
Legacy: MPGRN10501



Green Lin = New Underground Placement	
Yellow Line = Existing Conduit	
Blue Line = Aerial Placement	
New Fiber Vault	
Existing Fiber Vault	
New Pedestal	
Existing Pedestal	

USI CONTACT INFO:
Richard Miske
651-764-1411
rmiske@usi-universal.com

COMCAST CONTACT INFO:
Peter Drangeid
651-724-7815
peter_drangeid@cable.comcast.com

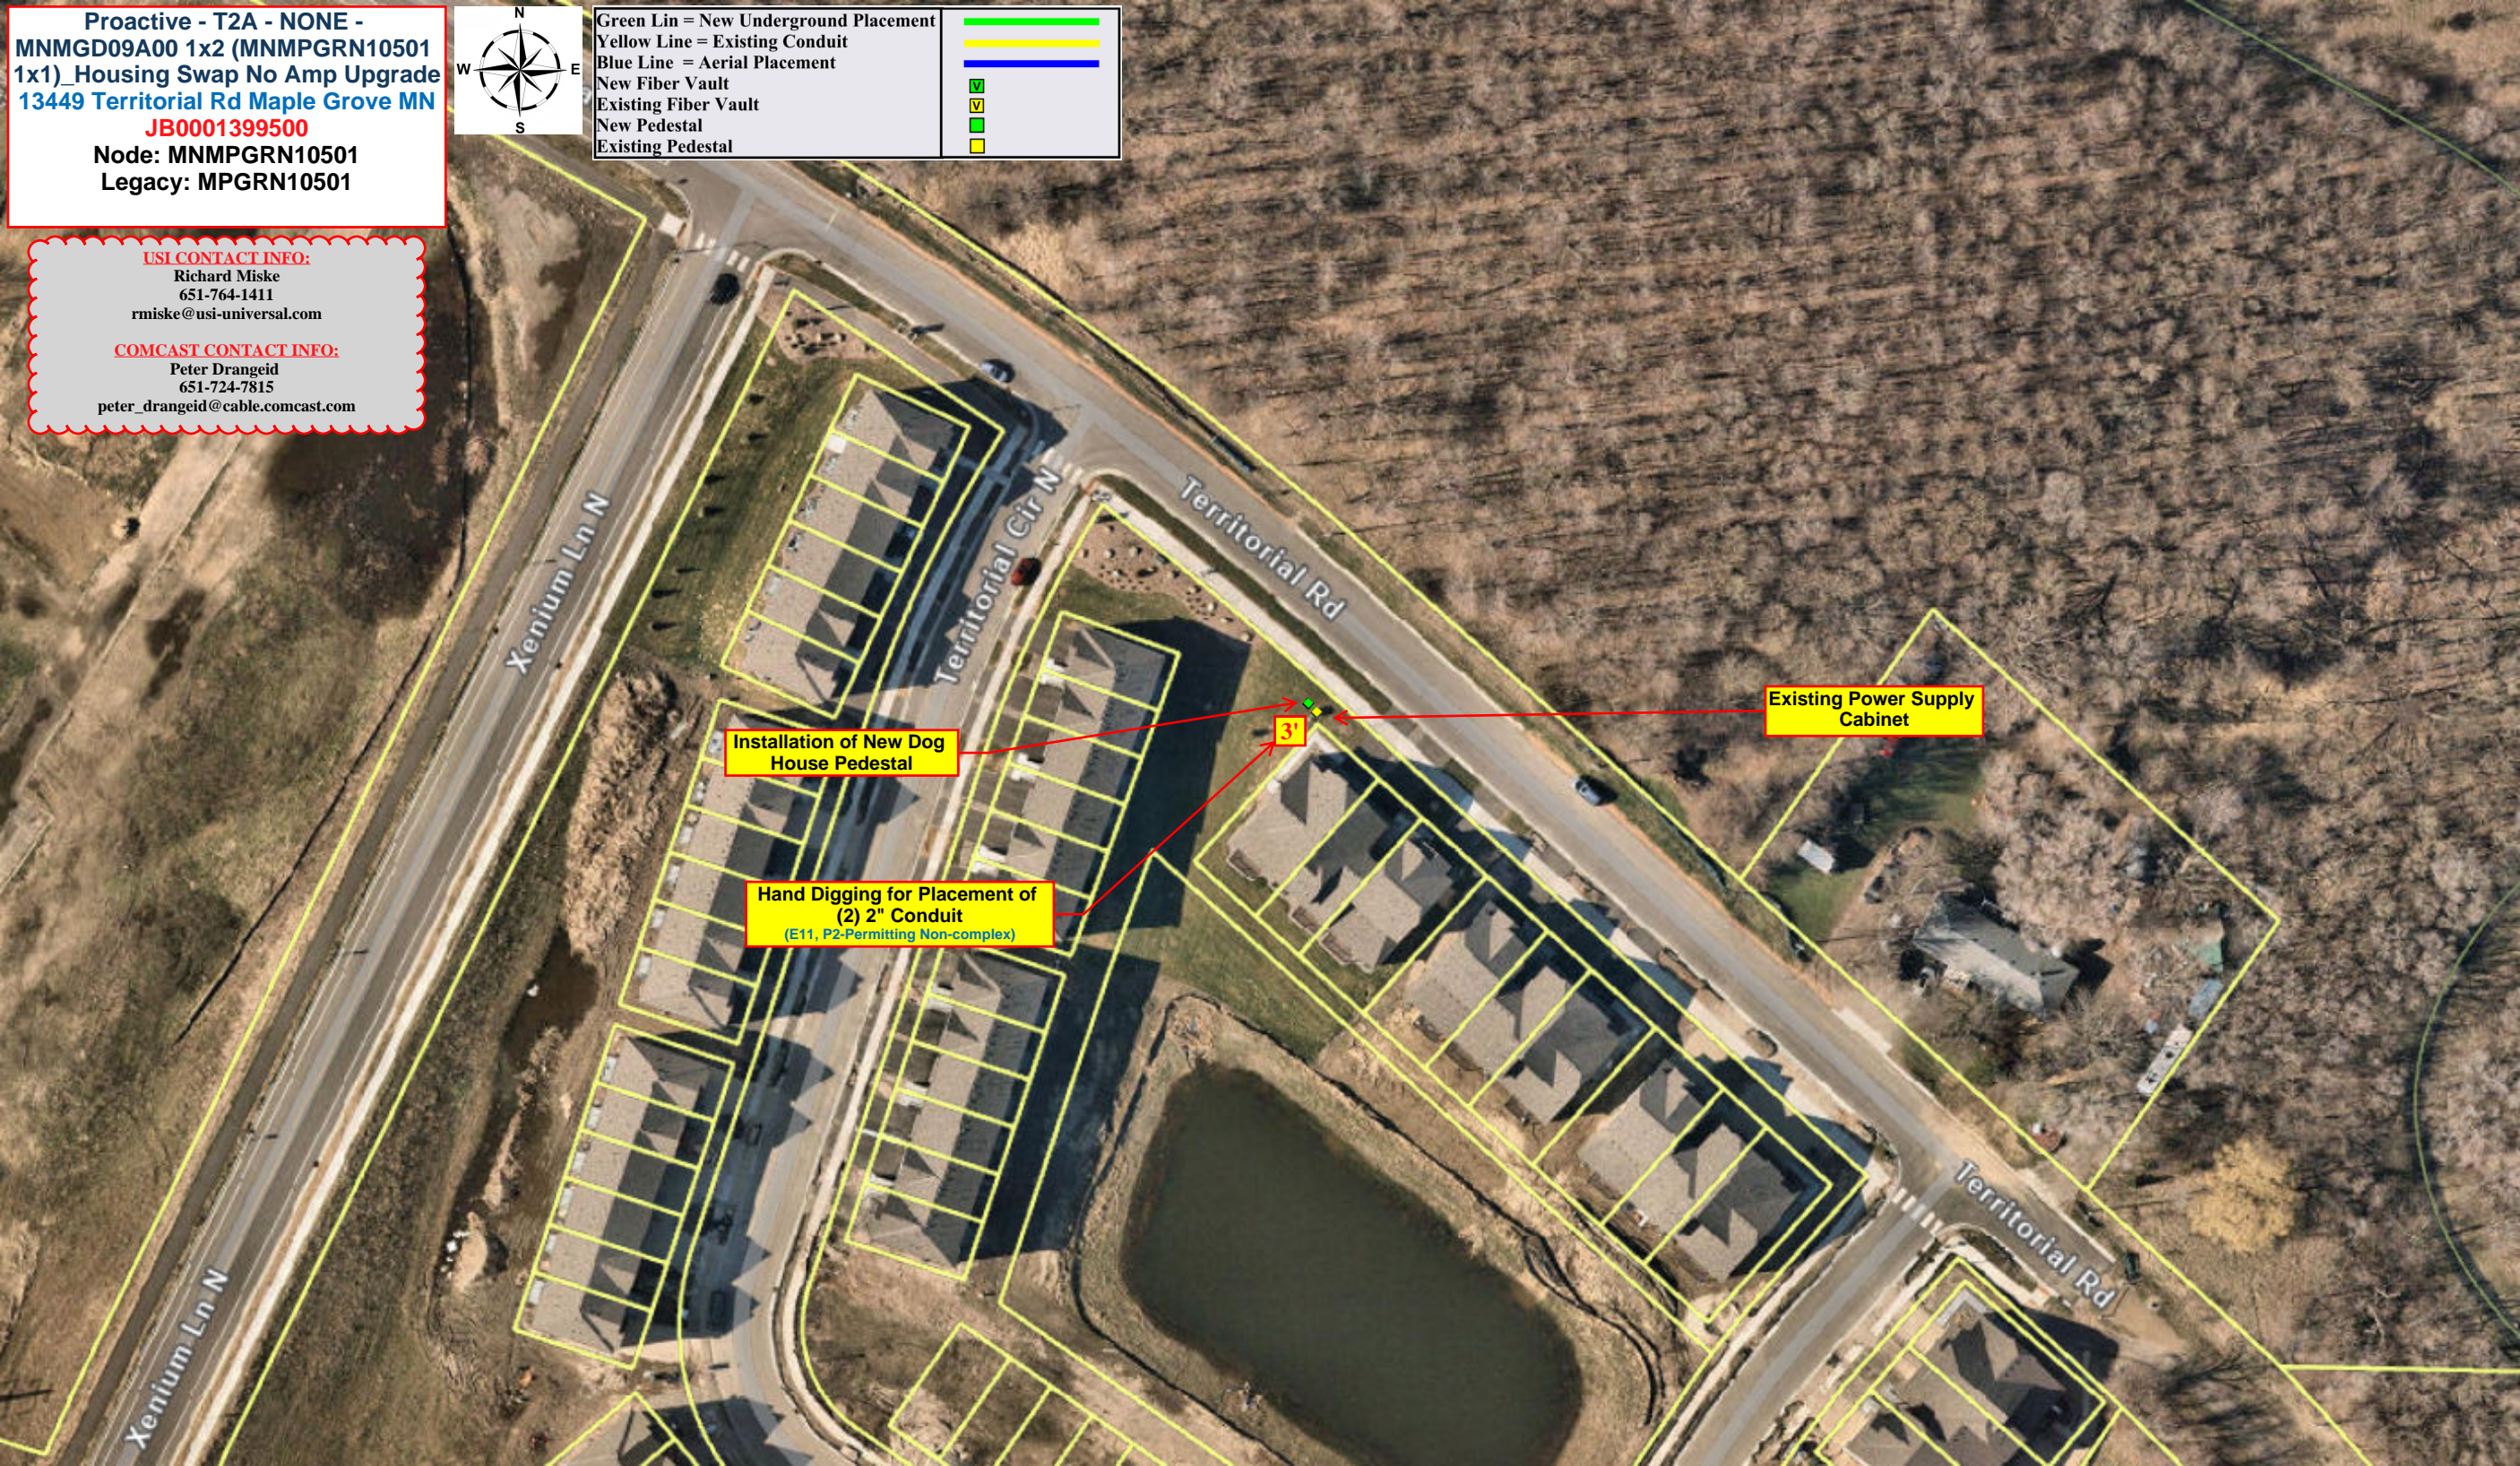

Installation of New Dog House Pedestal

Hand Digging for Placement of (2) 2" Conduit (E11, P2-Permitting Non-complex)

Existing Power Supply Cabinet

3