

LEGEND:

	IN SERVICE
	PROPOSED
	PROPOSED ABANDONED
	ABANDONED
	NOT PART OF PROJECT
	SEE NOTES

PIPE SUMMARY

4,520' 2" PE CL-6

4,520' TOTAL PIPE

CUSTOMER APPROVAL INSTALL:
 SIGNATURE: _____ TITLE: _____
 PRINTED NAME: _____ DATE: _____

The running line for natural gas main is approved, the site is within 6" of final grade, and ready for installation. Any and all private crossings have been clearly marked on site. I acknowledge that any alterations to the natural gas main that are needed after installation will be at the **Builder's/Developer's expense.**

When butt fusing to existing in-service polyethylene, visually inspect for the presence of hydrocarbon permeation immediately after removing fusion iron. If any bubbling is identified on the heated surface, do not join to new PE pipe. Allow to cool and cut this end off (12" length) and send to the Golden Valley Lab with street location and W.O. #. Complete tie-in/extension using an electrofusion coupling(s).

Document in field notes.

NOTE: BORE ALL PAVED STREETS AND DRIVEWAYS
 Minimum depth requirements for crossings of state highways and county roads is 60". Minimum depth requirements for crossings of city streets and township roads is 48". Minimum depth for parallel installations on state highways and county roads is 36". Minimum depth for parallel installations on city streets and township roads is 30". All steel pipe welds to be coated with 2 part epoxy.

INSTALL LOCATING POINTS AT A MAXIMUM SPACING OF 1,000 FT.

INSTALL 2" PE CL-6 - JOINT TRENCH - IN 10' D&UE

T = INSTALL 2" PE TEE
 C = INSTALL 2" PE CAP TO COVER SERVICE

Install, Clean and Test, and Put in Service; Proposed new main per CenterPoint Energy Construction and Service Manual.


Purge new main until essentially 100% gas reading is obtained on Combustible Gas Indicator. See CenterPoint Energy Construction and Service Manual Section CS-B-1.230 for purging mains into service.

Install a marker ball at a new end of main, at a valve, at each of a horizontal offset, at road crossings and at any fitting or pressure control identified as needing to be located in the future. Refer to CenterPoint Energy Construction and Service Manual section CS-B-1.310 for installation procedures.


Procedure for tapping or making tie-ins to existing gas mains: Verify existing gas main size, type, and location prior to tapping or making tie-in. Monitor and verify, using a pressure gauge, existing gas main Pressure Class within the bell hole of tap location or tie-in location prior to tapping or making tie-in.

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the state of Minnesota.

Signature: *Eric Yang*
 Eric Yang
 Date: 6/6/2024 License Number: 56613

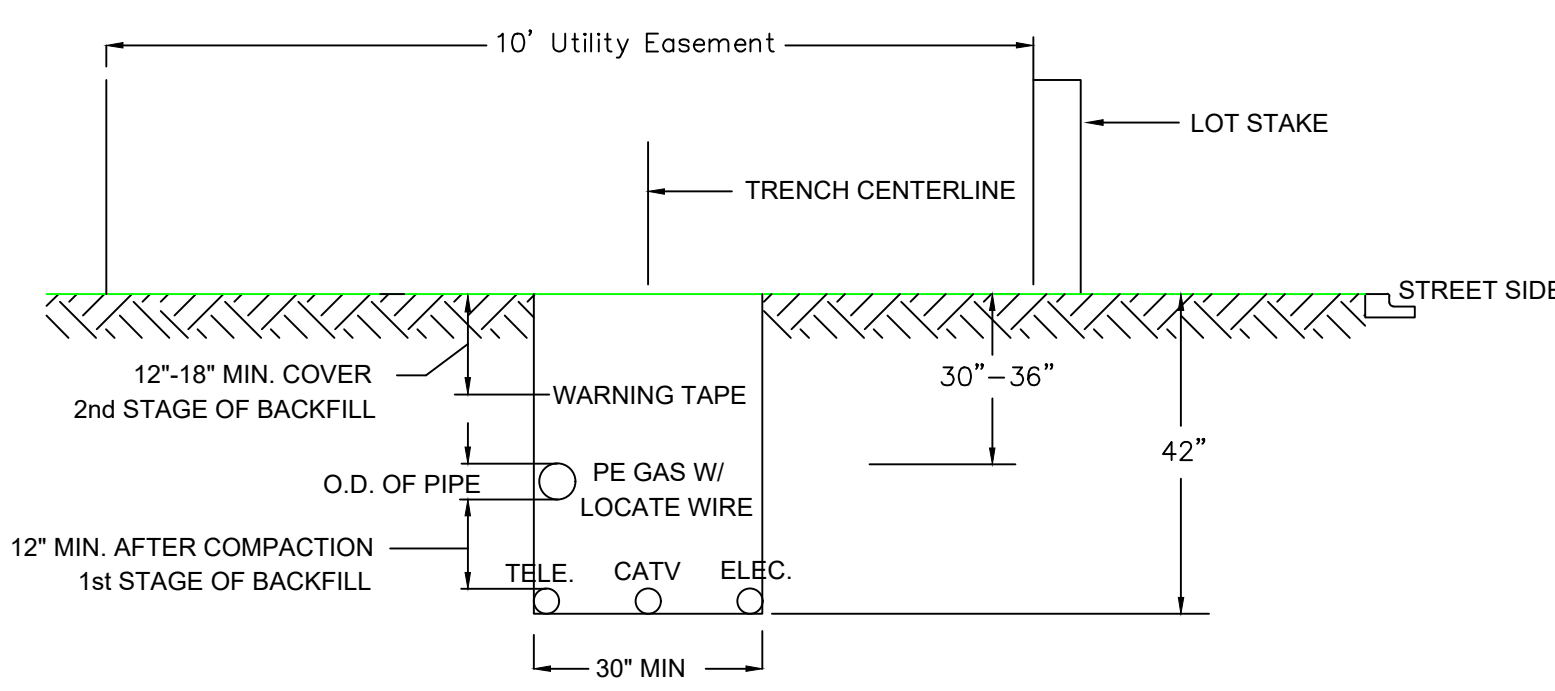

DUAL MAIN IN UTILITY EASEMENT

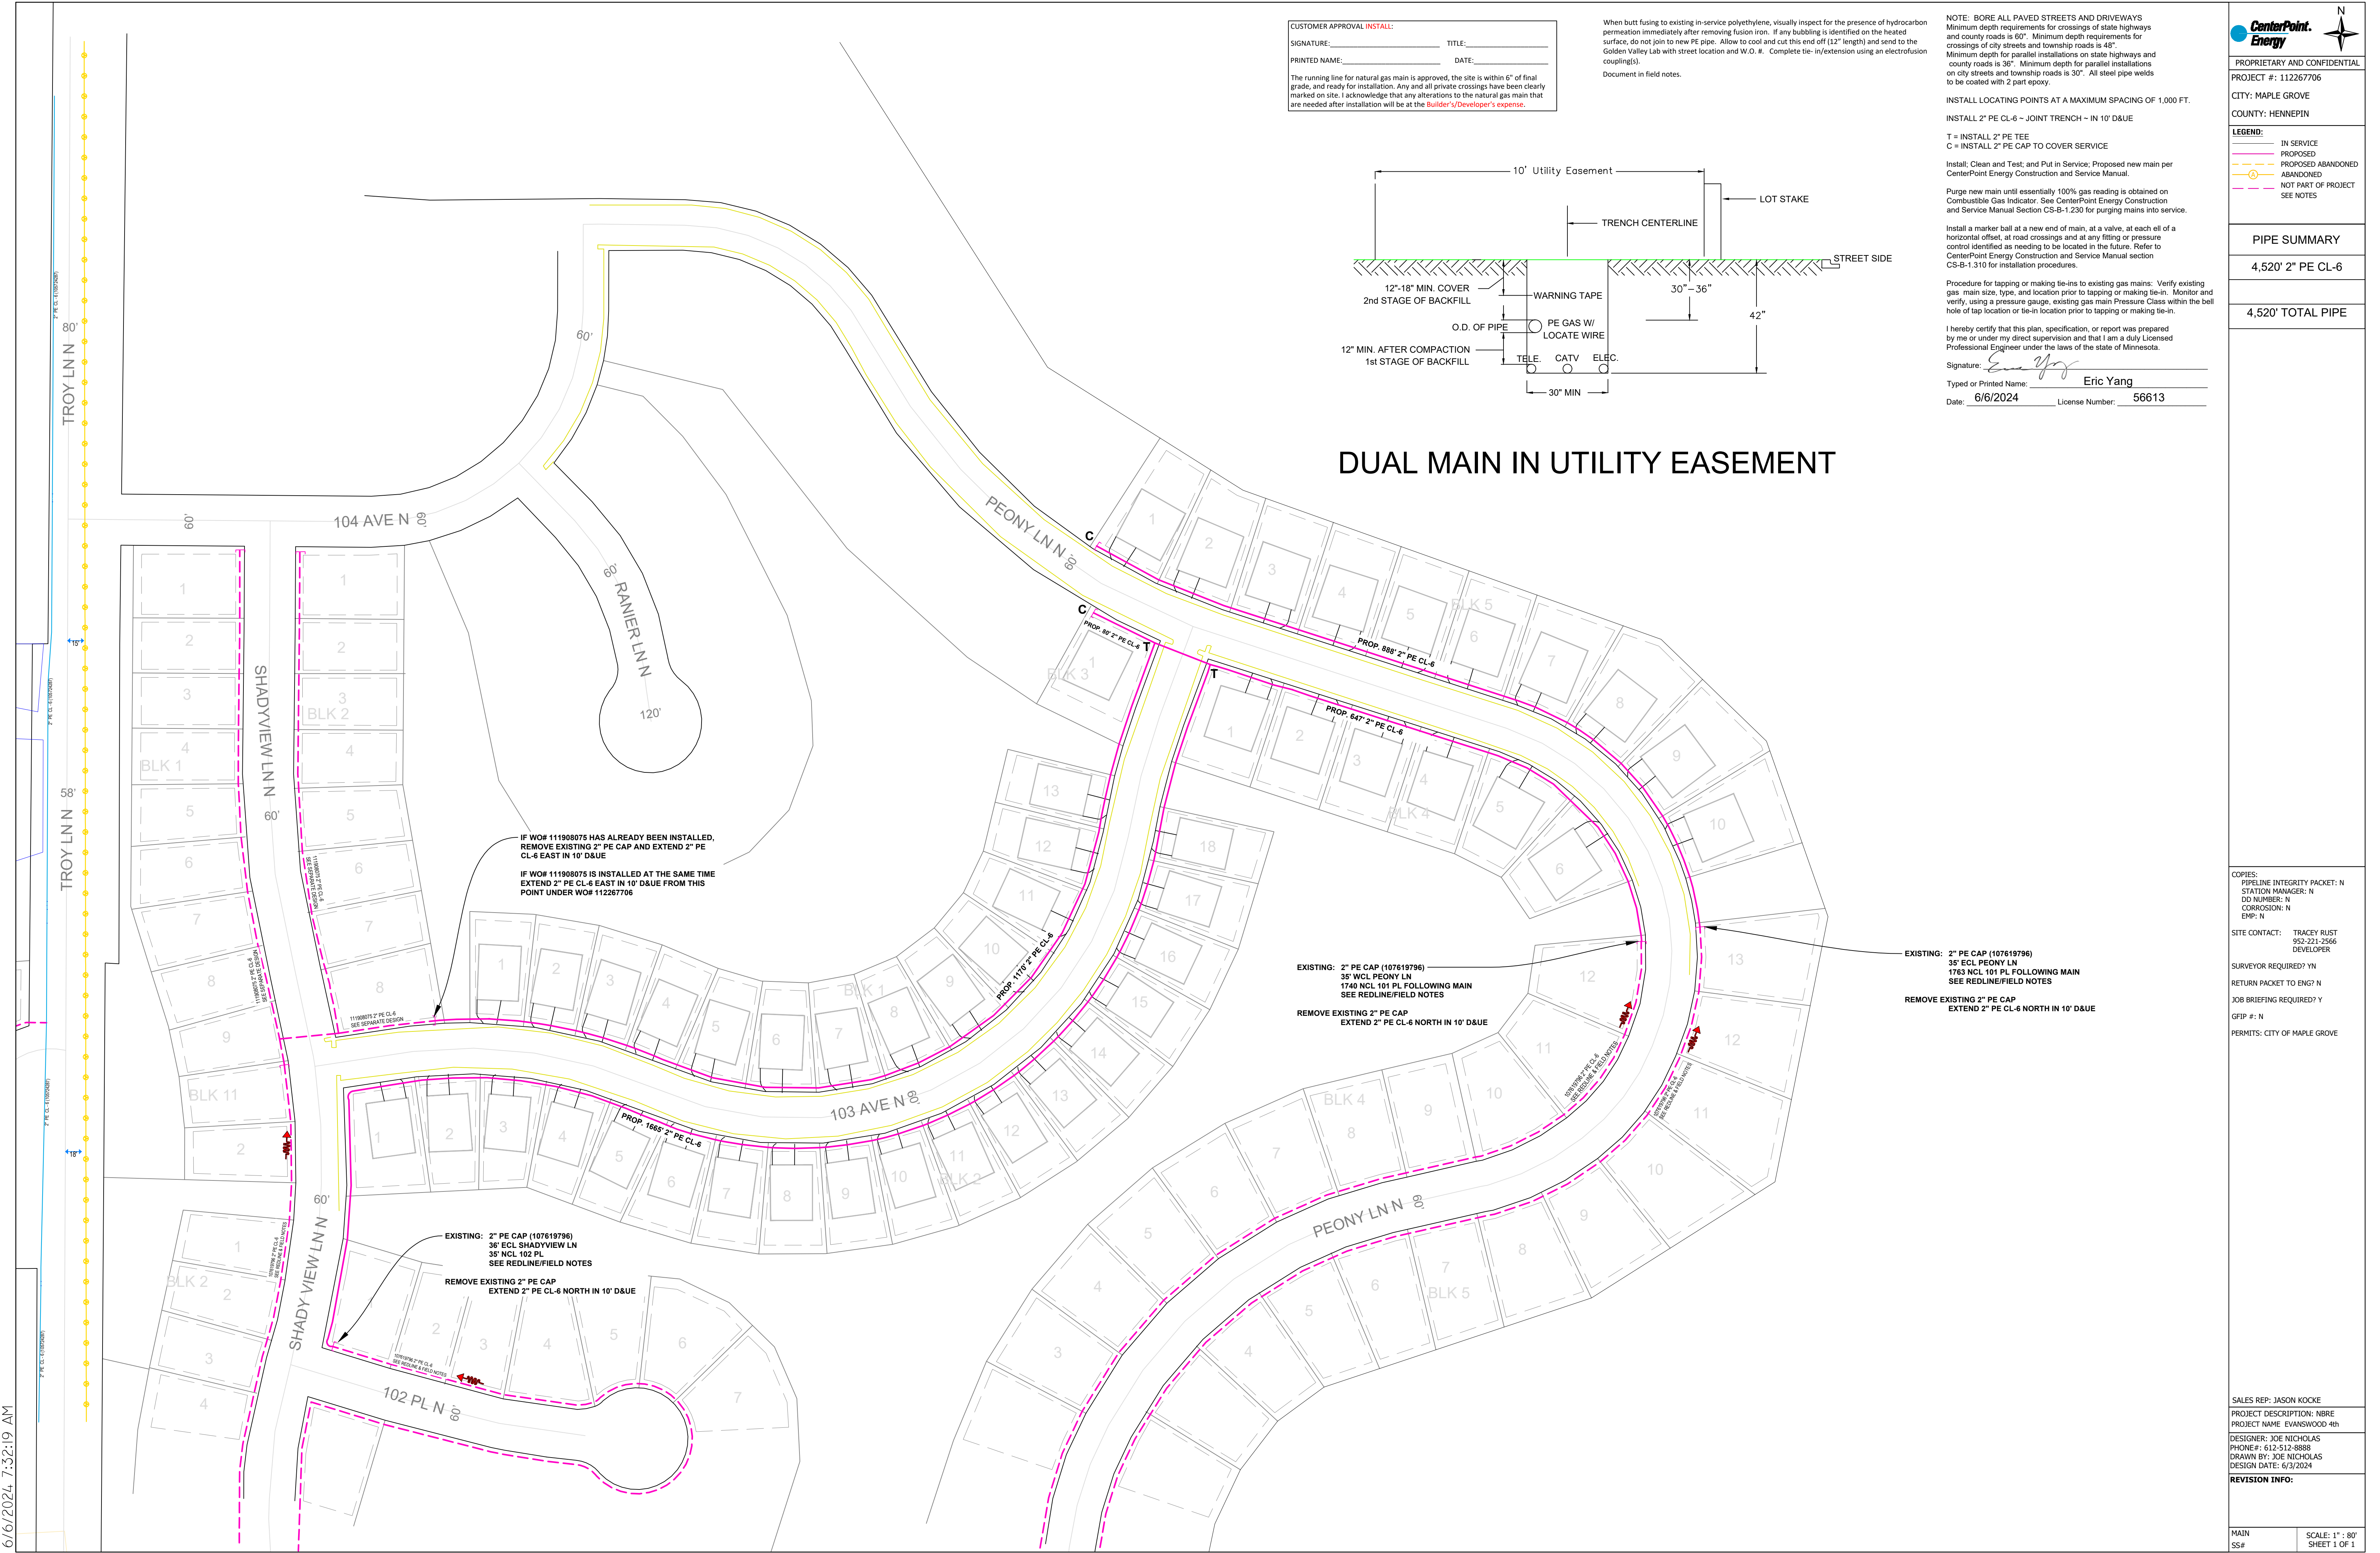

COPIES: PIPELINE INTEGRITY PACKET: N
 STATION MANAGER: N
 DD NUMBER: N
 CORROSION: N
 EMP: N

SITE CONTACT: TRACEY RUST
 953-221-2566
 DEVELOPER

SURVEYOR REQUIRED? Y/N

RETURN PACKET TO ENG? N

JOB BRIEFING REQUIRED? Y

GFIP #: N

PERMITS: CITY OF MAPLE GROVE

SALES REP: JASON KOCKE
 PROJECT DESCRIPTION: NBRE
 PROJECT NAME: EVANSWOOD 4th

DESIGNER: JOE NICHOLAS
 PHONE#: 612-512-8888
 DRAWN BY: JOE NICHOLAS
 DESIGN DATE: 6/3/2024

REVISION INFO: